






Daily Balancing Costs

Date:

27/12/2017

BSUoS Charge Estimate: £2.10/MWh
Total Outturn: £2.81m

■ BM Cost (Indicative)
■ AS Cost (Estimate)

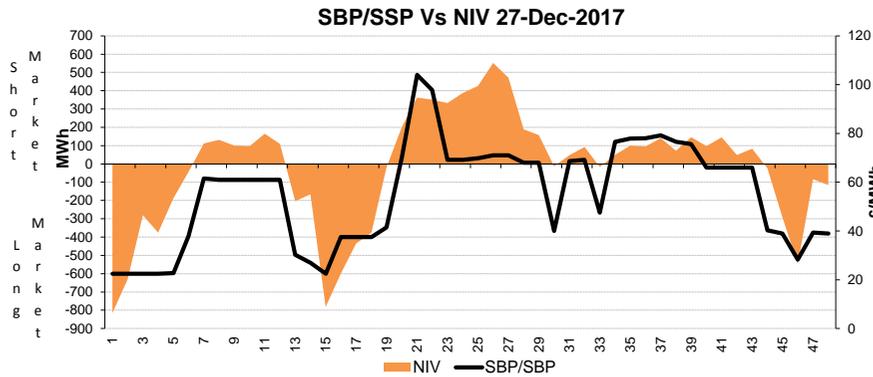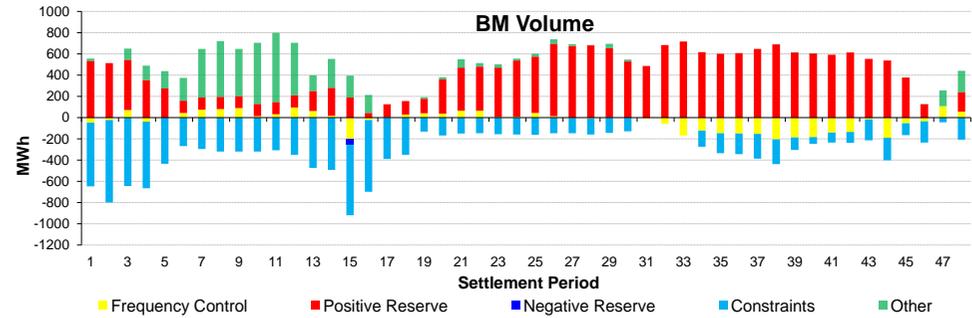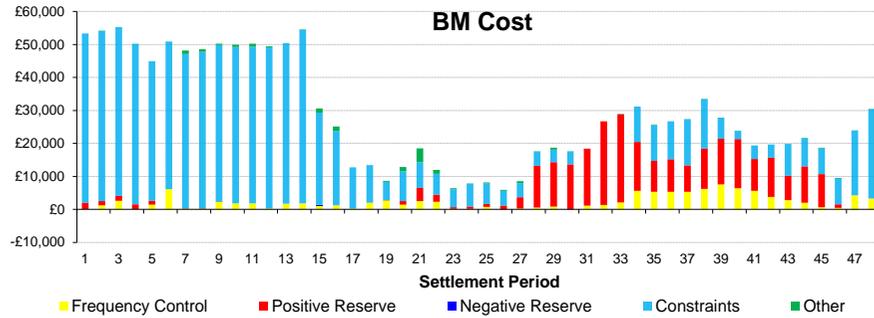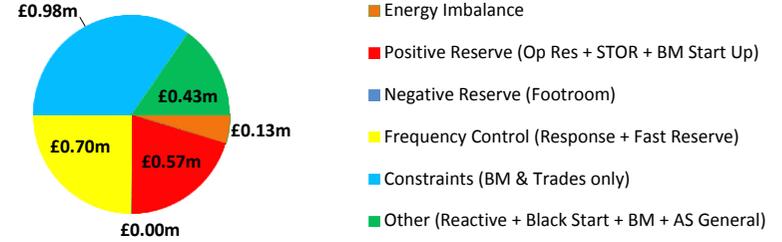

Commentary

750MW STOR ran for the morning peak, Trades were carried out on the Interconnectors to reduce their transfers to below the ROCOF limit in the early morning. Voltage actions were required at numerous regions across England and Wales; solved via trades and BM actions. A small number of BM actions were required to solve constraints on Scottish/England border. Additional ROCOF actions required in the late evening on the Interconnectors.