
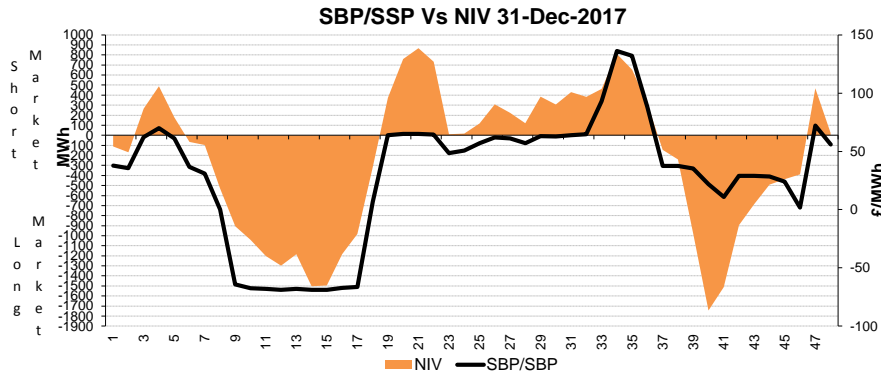
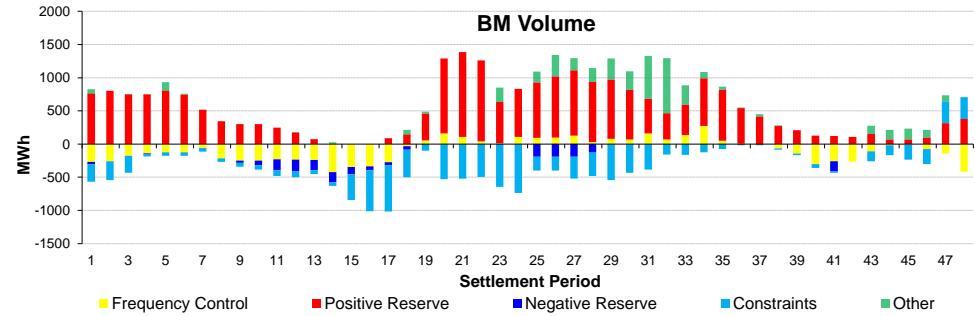
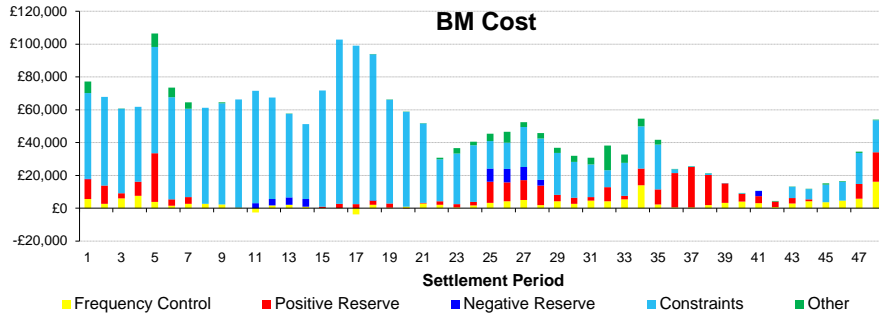
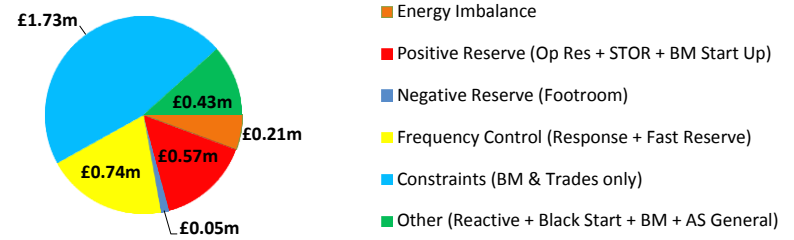


# Daily Balancing Costs

BSUoS Charge Estimate: £3.03/MWh  
 Total Outturn: £3.72m

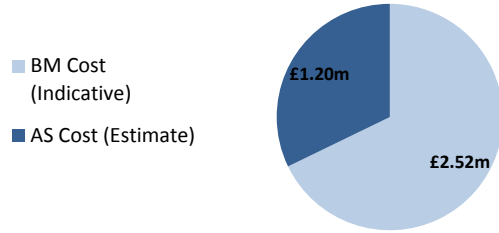

## Commentary

Around 600MW of STOR was run over the darkness peak for demand forecast errors. During the day many actions were taken against Scotland constraints. The fault on the Western HVDC link was still causing problems across the border. BM actions were used to solve with trades enacted later (same as yesterday). Trades were taken on the interconnectors for ROCOF. Several units were traded and bought for voltage control in the North, South East and South Wales.