
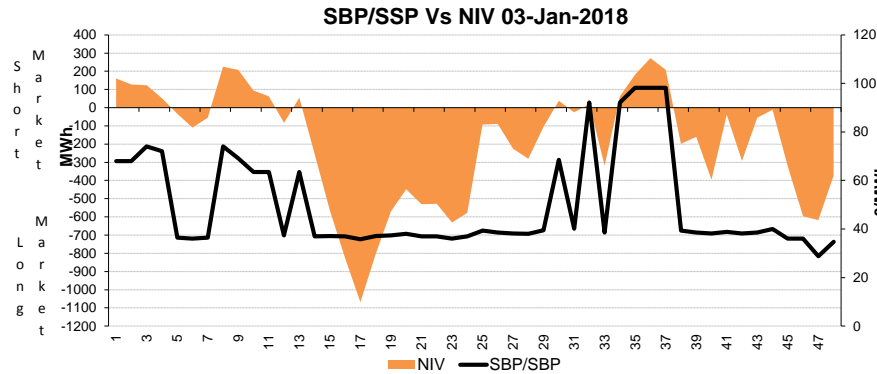
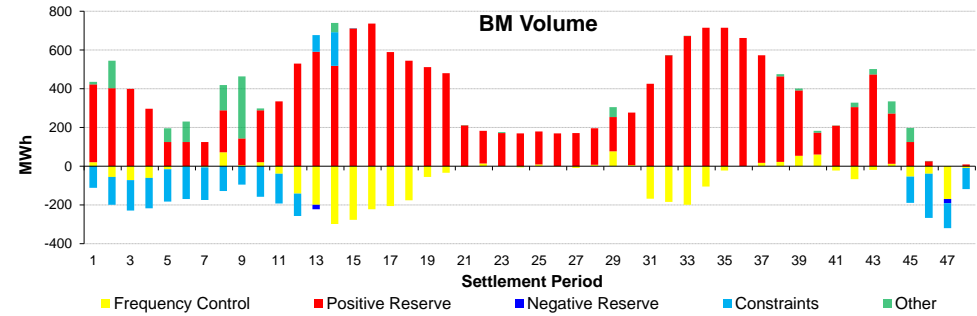
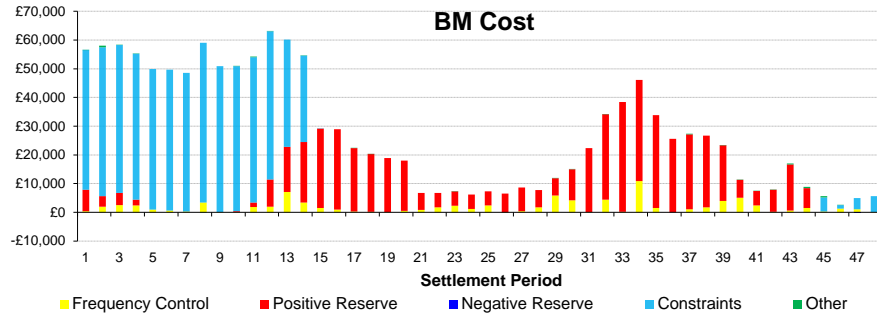
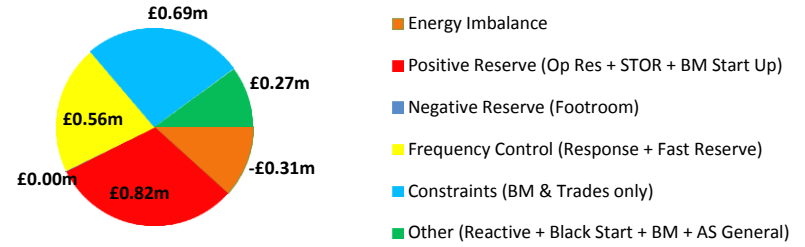


Daily Balancing Costs

BSUoS Charge Estimate: £1.50/MWh
Total Outturn: £2.03m

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

Market prevalently long throught out the day. Residual effect of the Storm Eleanor was visible on Wednesday which remained critical until late afternoon reverted to normal towards the end of the day. ROCOF and Voltage constrains were solved through both Trades and BM activities. Dynamic Response was increased due to wind volatility which also helped to prevent critical Frequency deviation after two BMUs tripped at restart early in the morning. The loss was recovered by an early BMU Sync.