
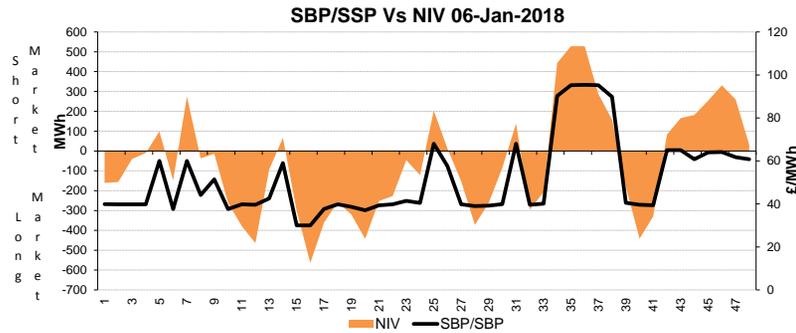
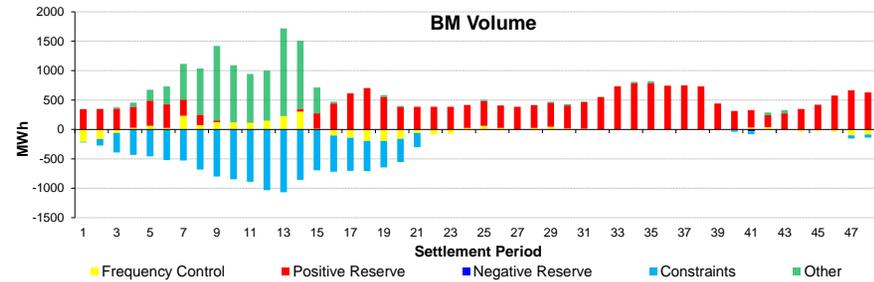
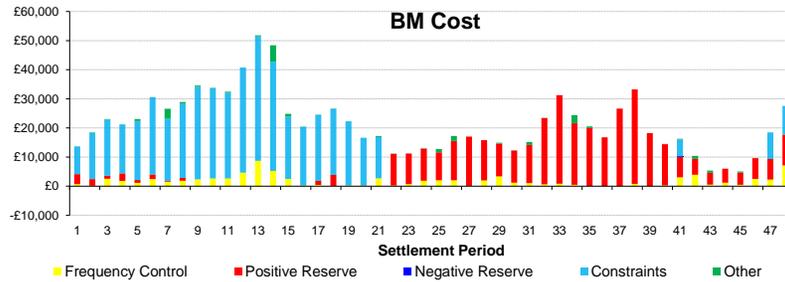
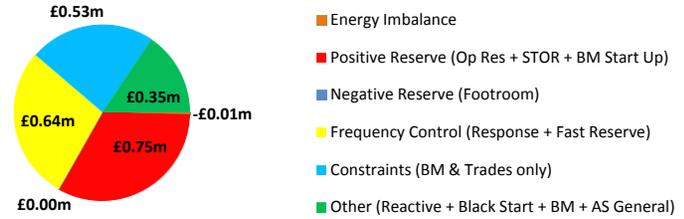


Daily Balancing Costs

BSUoS Charge Estimate: £1.68/MWh
 Total Outturn: £2.27m

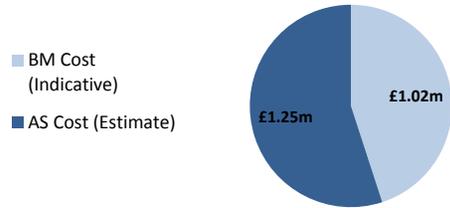

Commentary

During the Darkness peak 385MW of STOR was run. Three extra machine were run for positive reserve. Constraint costs were mainly Voltage and ROCOF issues. Both were largely resolved via trades on interconnectors (ROCOF) and conventional generation (Voltage and ROCOF). Additional BM actions were required for Scotland. Some additional machines were used for voltage in Wales.