
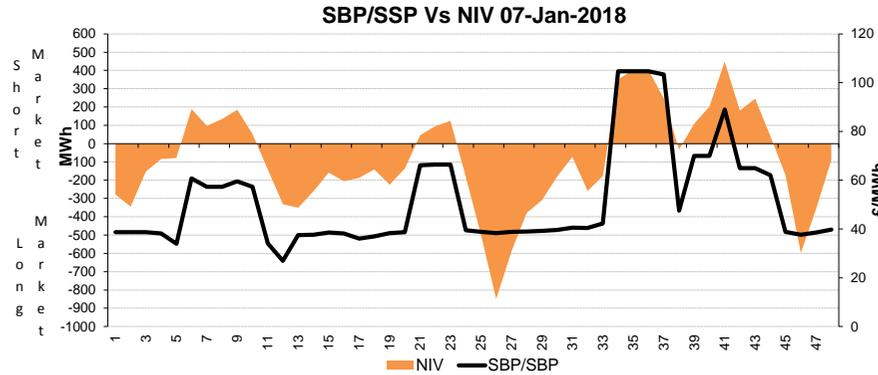
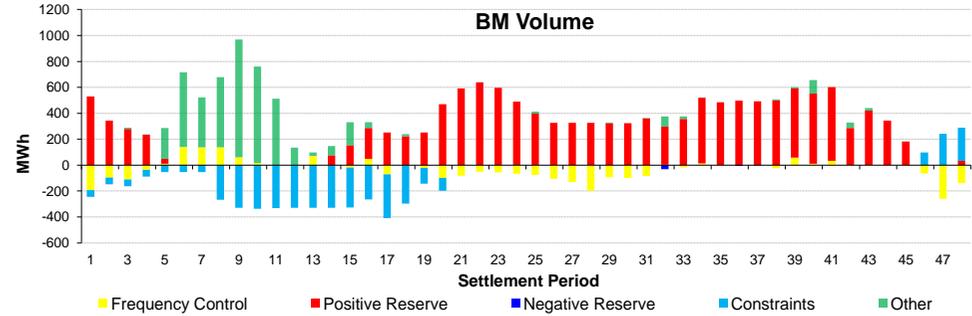
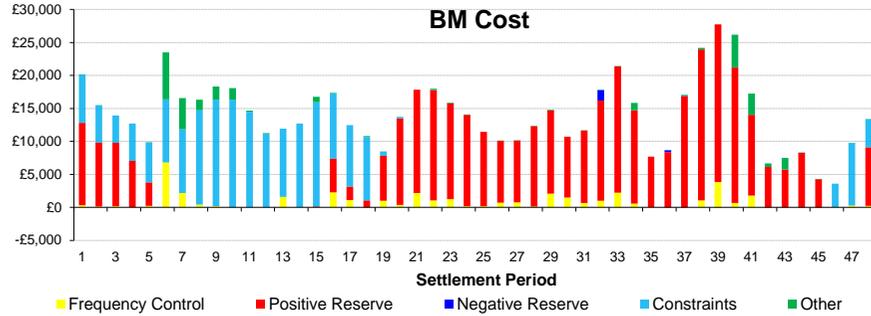
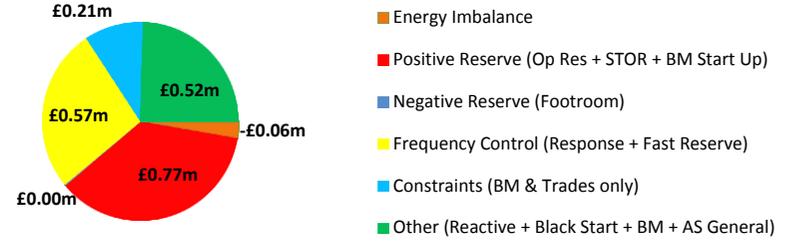


# Daily Balancing Costs

Date: 07/01/2018

BSUoS Charge Estimate: £1.54/MWh  
Total Outturn: £2.01m

■ BM Cost (Indicative)  
■ AS Cost (Estimate)



## Commentary

This Sunday was characterized by a mixed market, which was short over a few settlement periods during the night and between the afternoon and the darkness peak. During the morning hours the demand turned out lower than expected due to 1.5 GW of PV generation under forecasted. Overnight RoCoF was regulated with multiple trades on the interconnectors. These were also supported by some BM actions. Over the same timeframe, the voltage levels in England were regulated with a mix of trades and BM actions.