


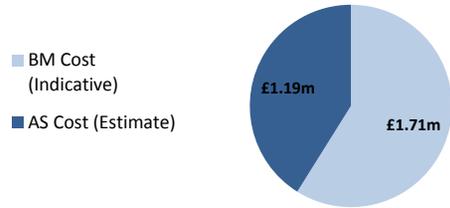
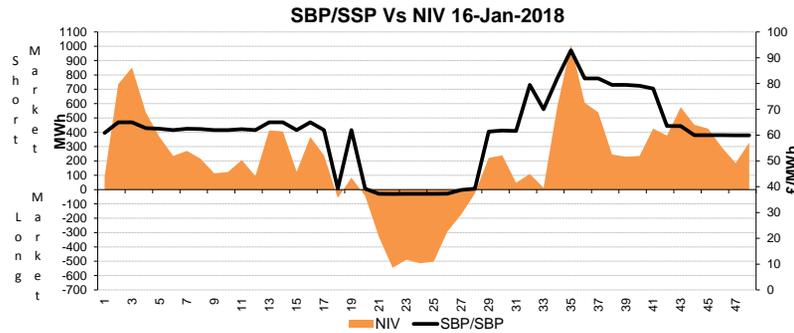


Daily Balancing Costs

BSUoS Charge Estimate: £1.91/MWh
Total Outturn: £2.90m

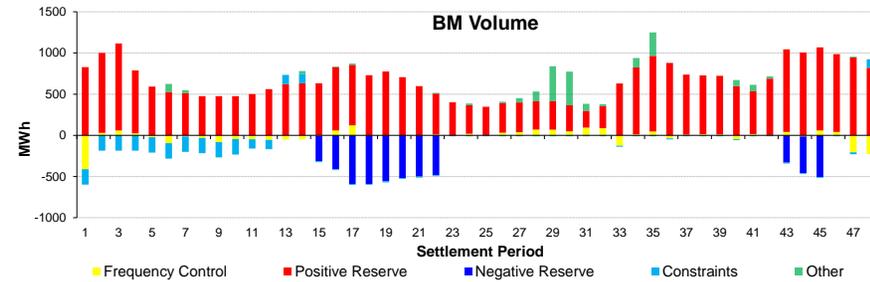

- Energy Imbalance
- Positive Reserve (Op Res + STOR + BM Start Up)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM + AS General)

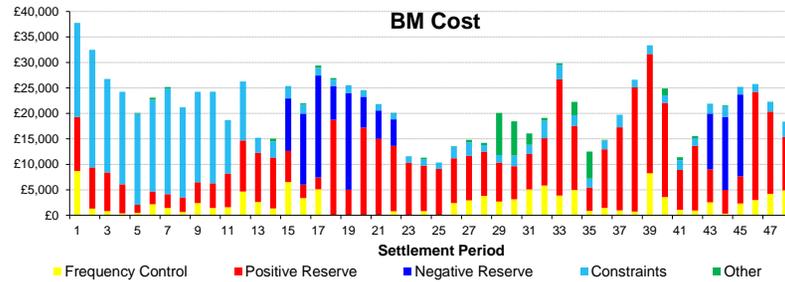

Commentary

300 MW of STOR was run in the morning.
 There was 1700MW of wind cut off last night, the only wind action was against a wind farm in Scotland. A few actions were taken for voltage control in the Lincoln area. The interconnectors were bought down for ROCOF.