






# Daily Balancing Costs

BSUoS Charge Estimate: £1.30/MWh  
Total Outturn: £1.86m

BM Cost (Indicative)  
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR + BM Start Up)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM + AS General)

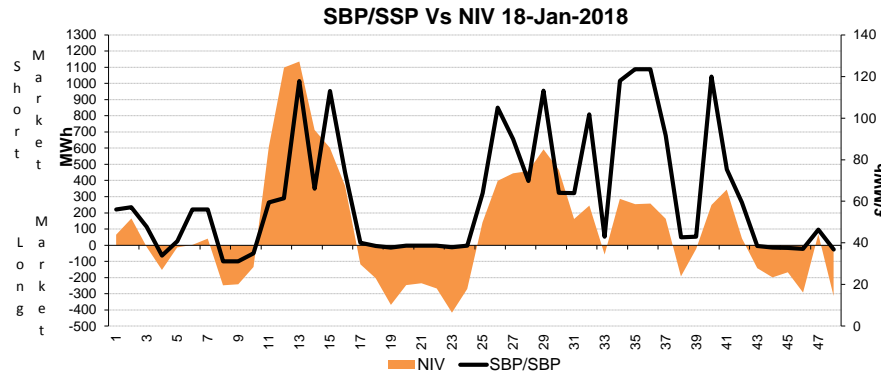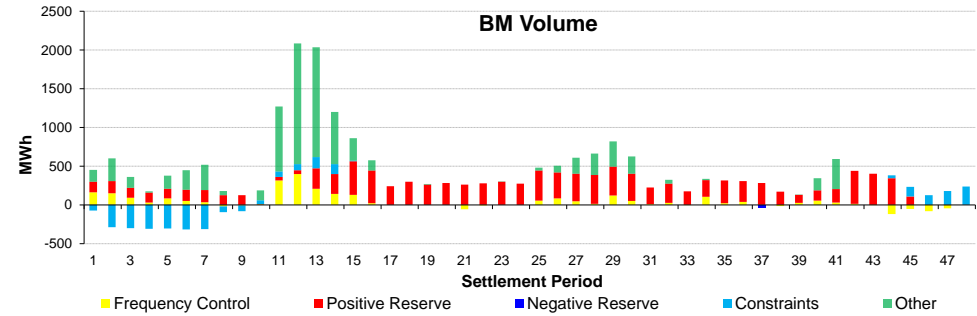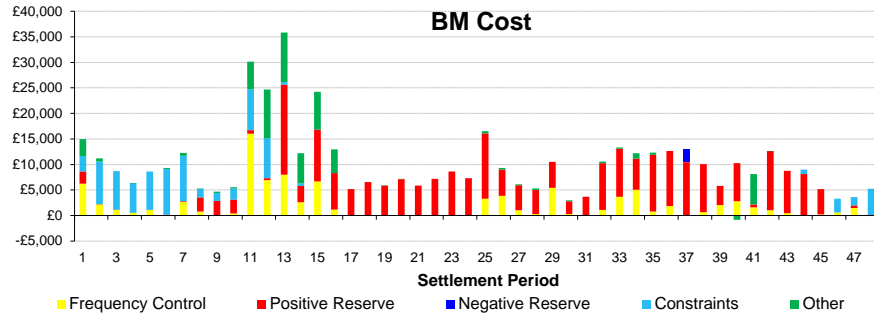

## Commentary

400MW of STOR was run in the morning  
Trades on the interconnectors and BM actions were required for ROCOF in the early morning. A few actions were taken in the BM for voltage control in the Midlands and Lincoln Area.