






Daily Balancing Costs

BSUoS Charge Estimate: £1.02/MWh
 Total Outturn: £1.28m

BM Cost (Indicative)
 AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR + BM Start Up)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM + AS General)

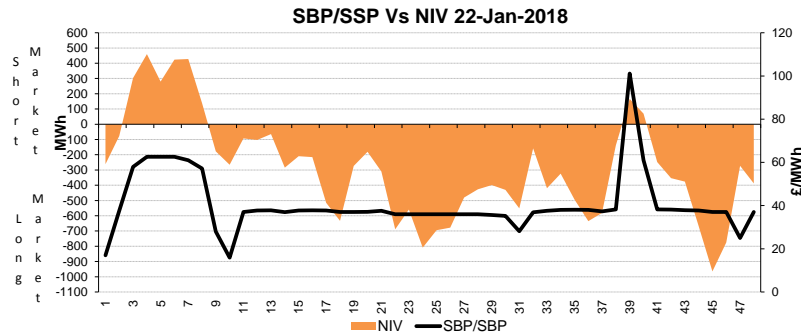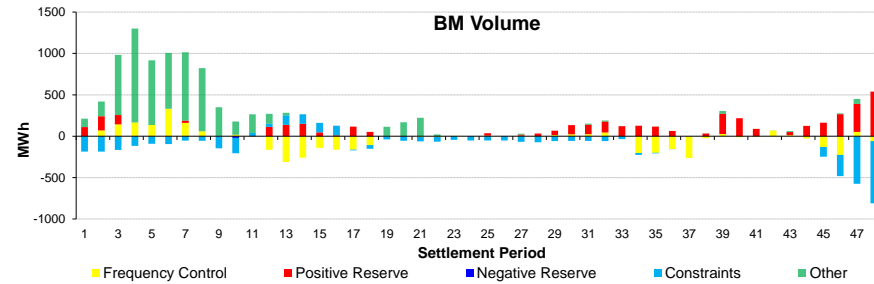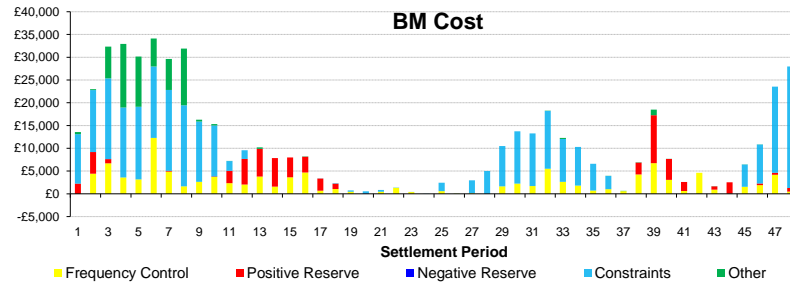

Commentary

Four machines were held for regulating reserve over the day. Wind generation was reasonably high on Monday requiring some wind farms to be bid off for the Scotland England borders. The interconnectors were traded down for ROCOF. Some voltage plant was used in the midlands overnight.