
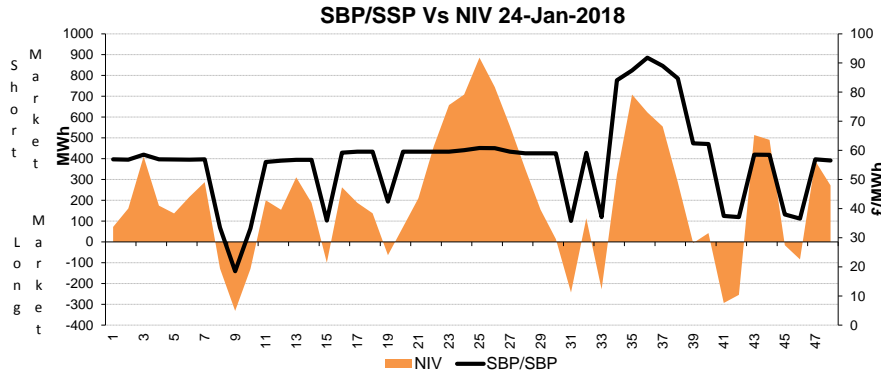
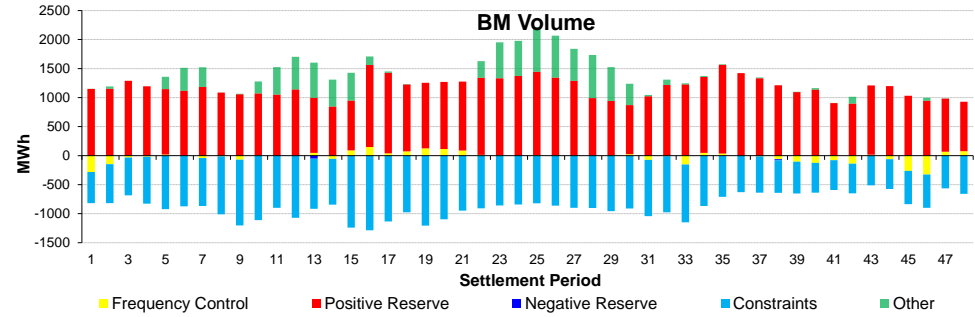
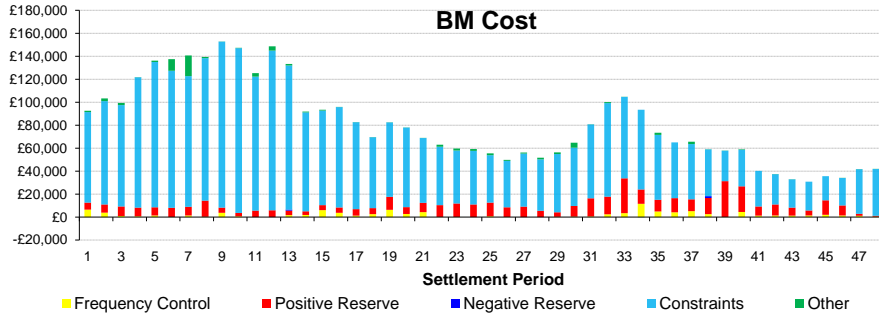
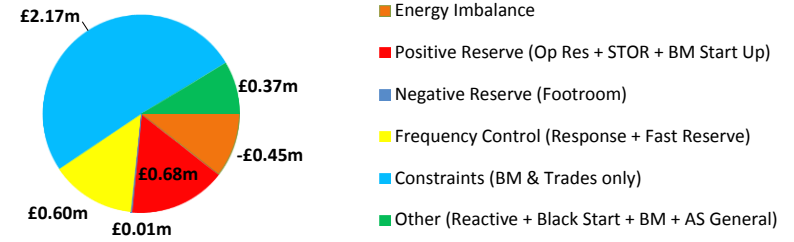


# Daily Balancing Costs

BSUoS Charge Estimate: £2.29/MWh  
 Total Outturn: £3.37m

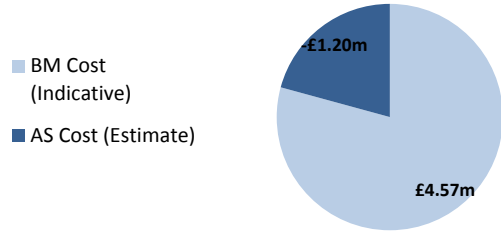

## Commentary

The evening peak, demand was 2.5GW under forecast.  
 1GW of wind generation was pulled back, due to overnight constraints on the Scotland and England border.  
 Several machines were run for voltage control in Wales and in the midlands overnight.