
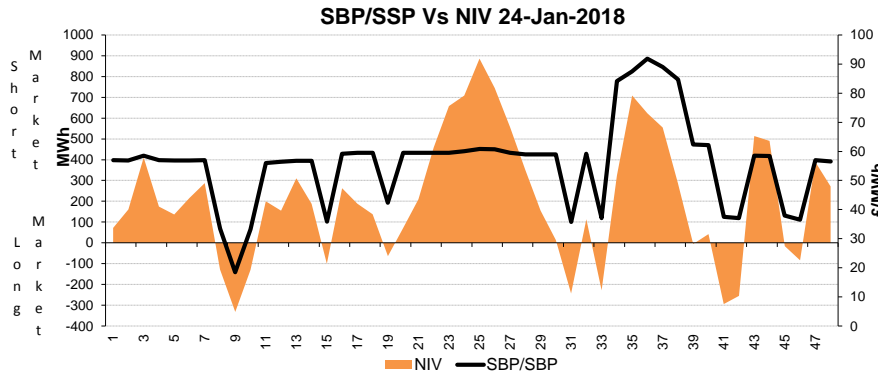
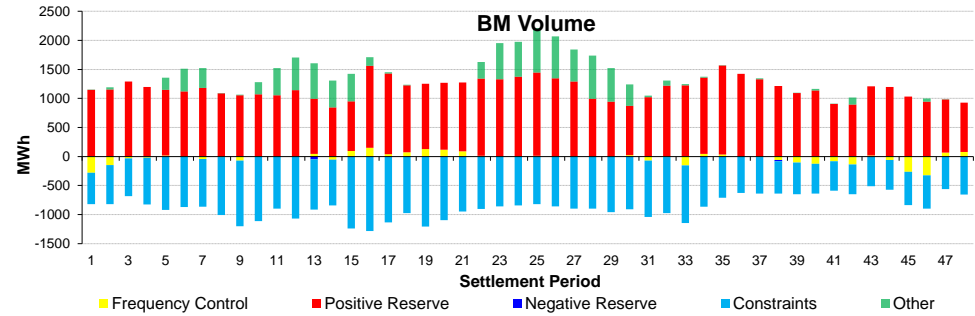
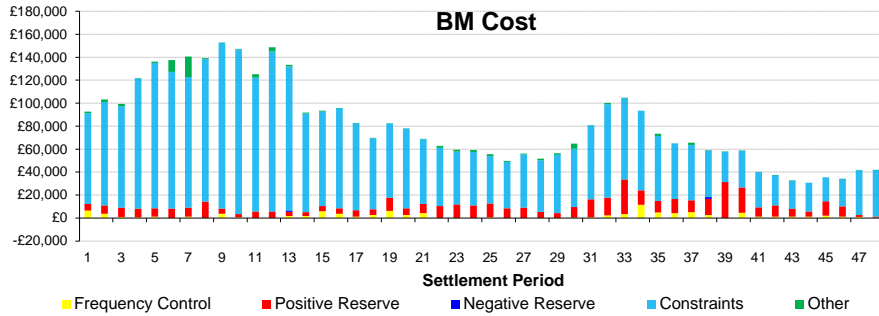
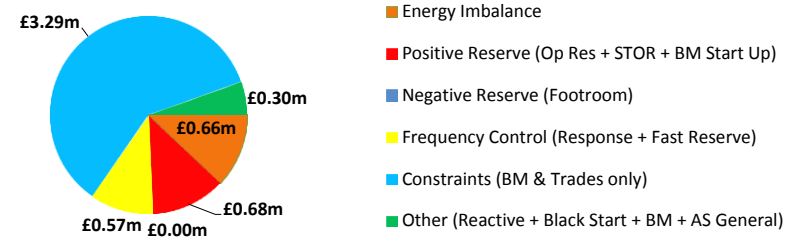


Daily Balancing Costs

BSUoS Charge Estimate: £3.52/MWh
Total Outturn: £5.50m

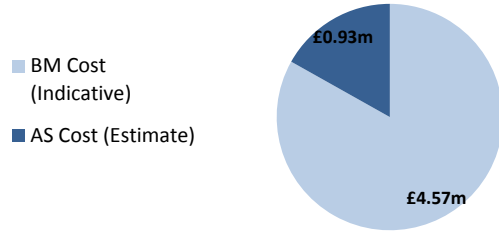

Commentary

450MW of STOR was utilised over the Darkness Peak. BM actions were required throughout the day for constraints on Scotland England, border, trades were also carried out to manage constraints in North West Scotland. Numerous Trades on the interconnectors and BM actions were required for ROCOF both early morning and late night. Voltage levels in England were regulated with a mix of trades and BM actions.