
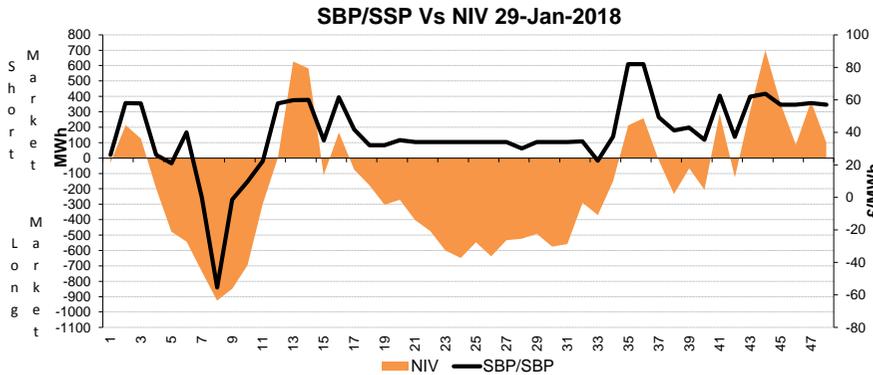
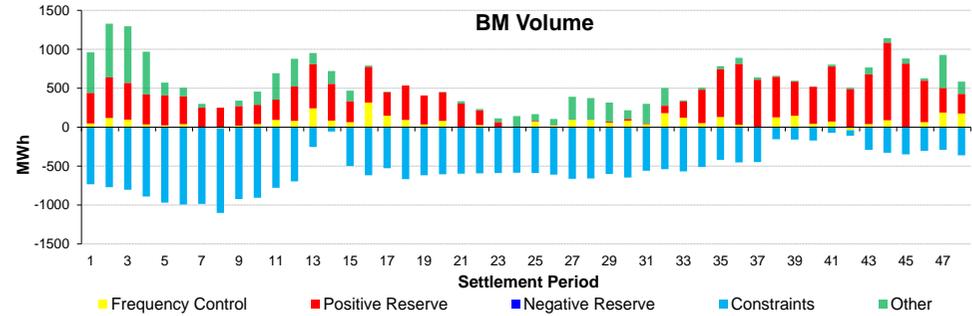
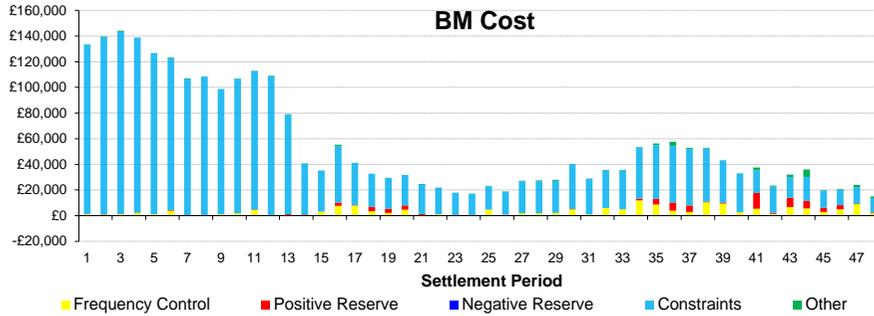
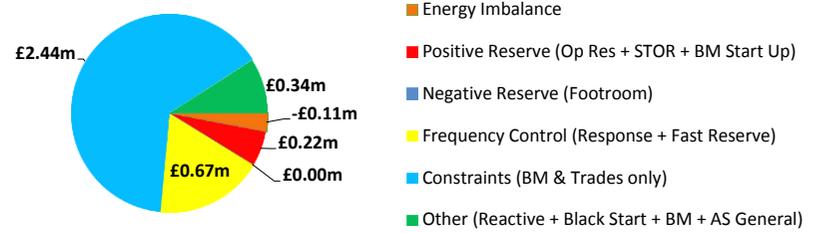


Daily Balancing Costs

BSUoS Charge Estimate: £2.41/MWh
Total Outturn: £3.56m

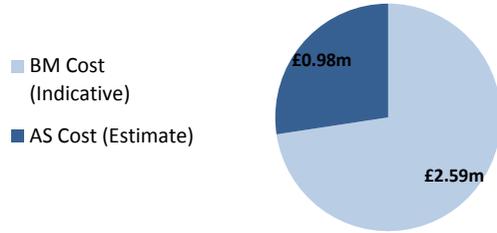

Commentary

390MW of STOR was run in the morning and 430MW was utilised for the evening peak. Trades & BM actions were taken for constraints on Scotland England boarder in the morning. Numerous Trades on the interconnectors were required for ROCOF in the early part of the day. Overnight voltage levels in England were managed with a mix of Trades and BM actions.