
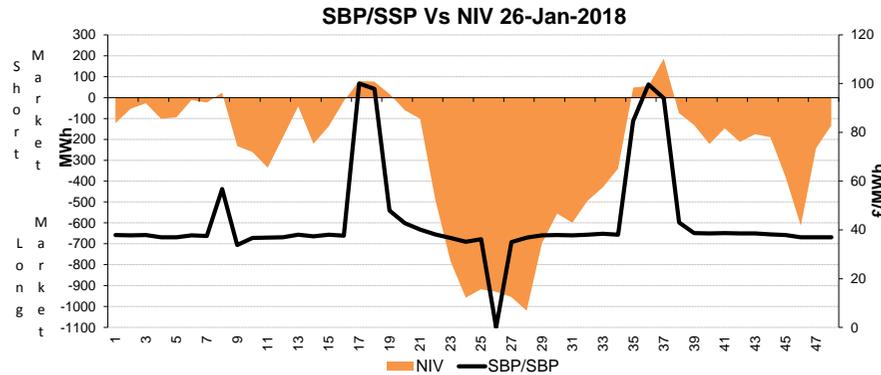
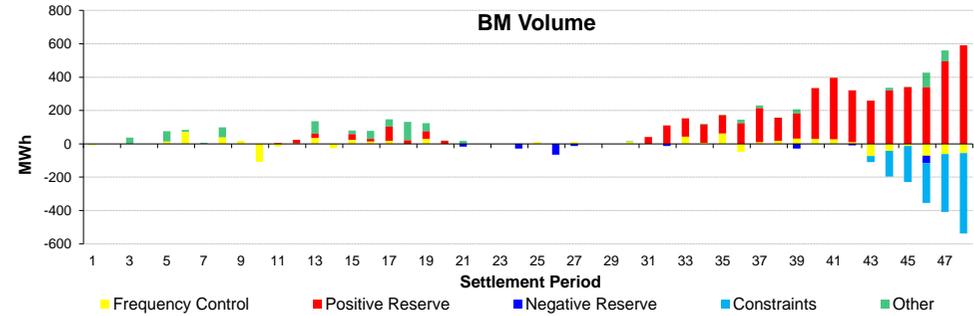
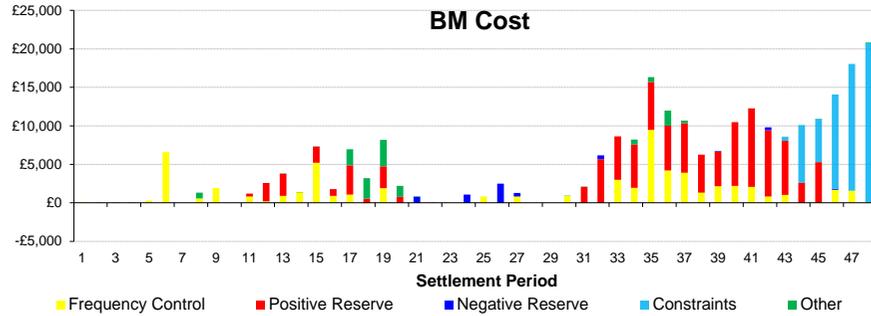
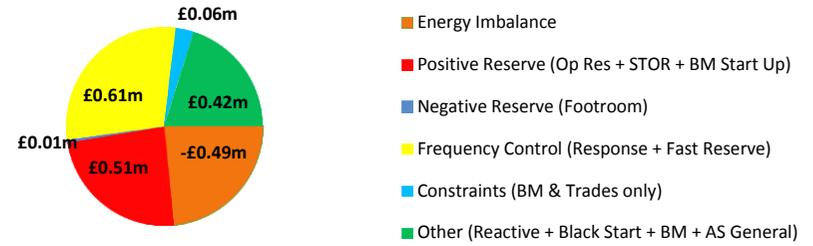


Daily Balancing Costs

BSUoS Charge Estimate: £0.90/MWh
 Total Outturn: £1.12m

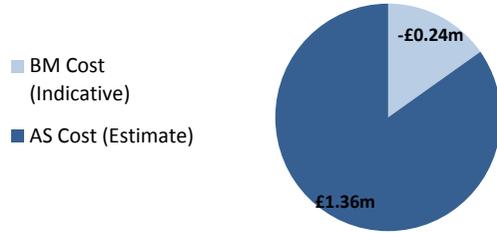

Commentary

The market was markedly long throughout the 24 hours and no relevant action were taken for network balancing purposes. As forecasted a rapid increase in wind from the Friday evening triggered network powerflow restrictions between England and Scotland from the late evening. These were solved with BM actions.