
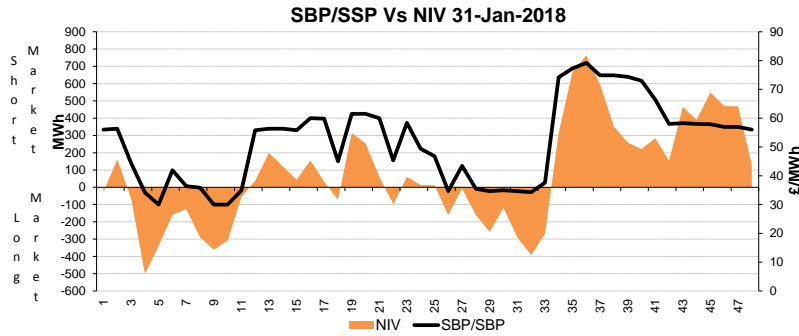
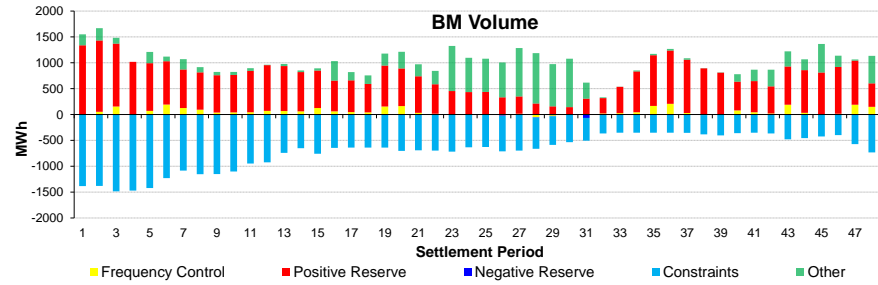
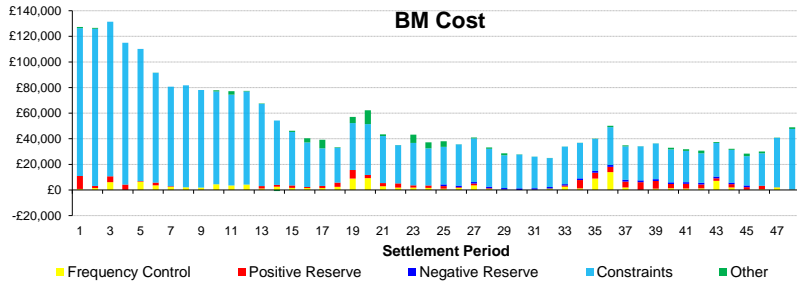
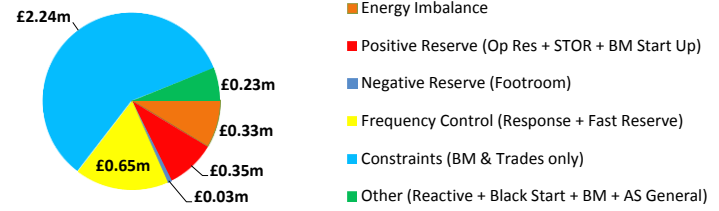


Daily Balancing Costs

Date:

31/01/2018

BSUoS Charge Estimate: £2.50/MWh
Total Outturn: £3.82m

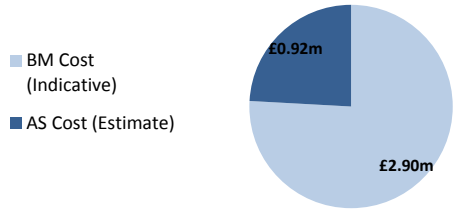

Commentary

358 MW of STOR was run over the evening peak. Large demand errors were realised in the morning and overnight.

Wind shortfalls of up to 1GW throughout much of the day.

BM actions were taken for constraints over the Scotland England border. Trades were taken against wind in North West Scotland. Machines were bought on for voltage in South Wales overnight. Up to 300 MW Interconnector trades were carried out on both interconnectors for ROCOF reasons.