
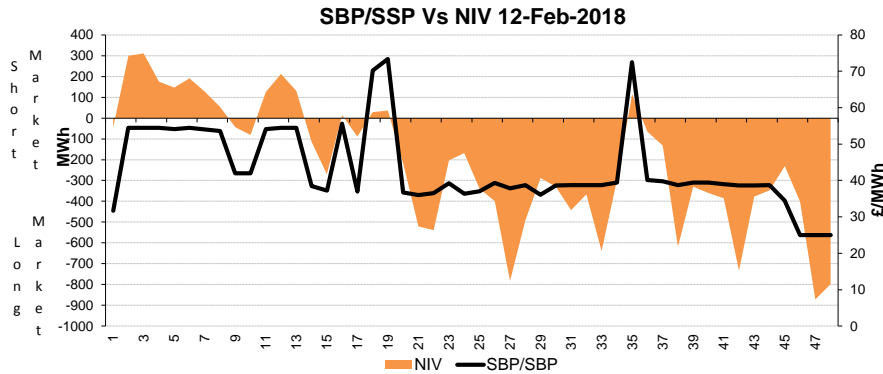
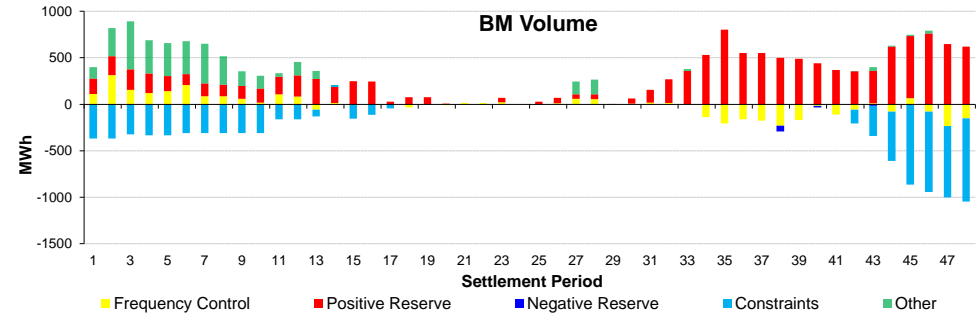
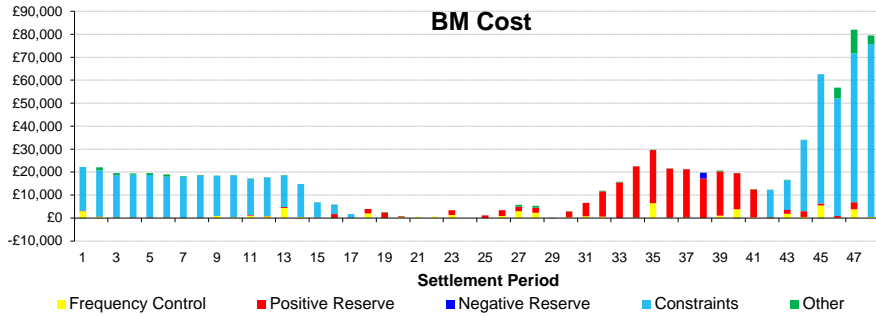
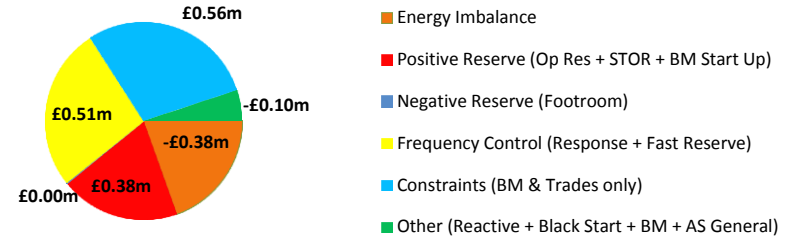


Daily Balancing Costs

BSUoS Charge Estimate: £0.85/MWh
Total Outturn: £0.98m

■ BM Cost (Indicative)
 ■ AS Cost (Estimate)



Commentary

Five machines were held for regulating reserve during the day. Trades were carried out on the interconnectors for ROCOF and Margin requirements. Some BM actions were taken in Scotland to reduce power across the border due to a constraint. Some machines were run for voltage support in South Wales.