
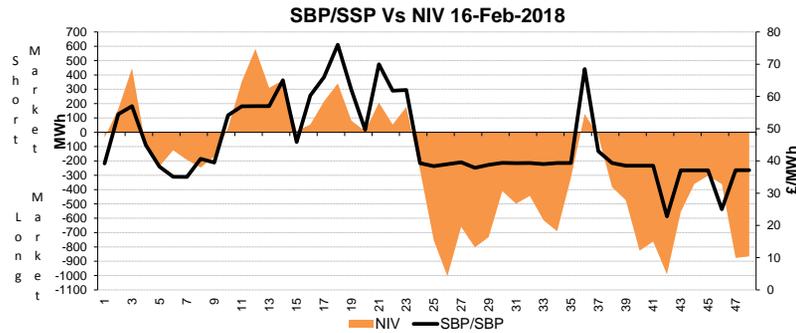
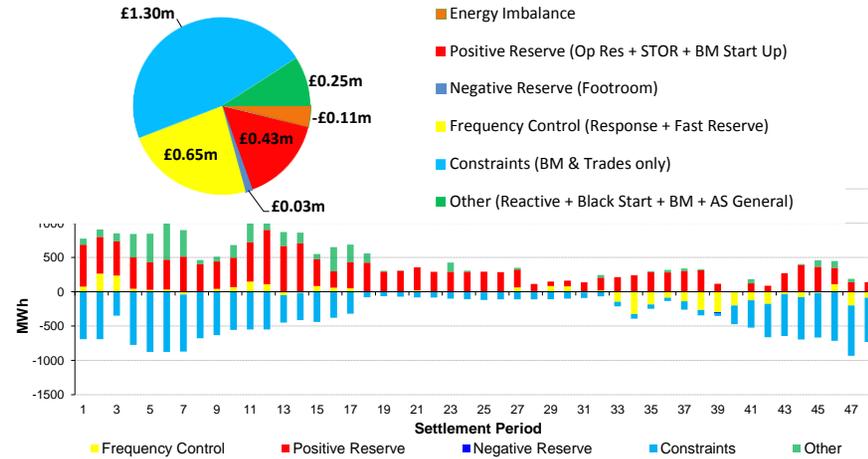
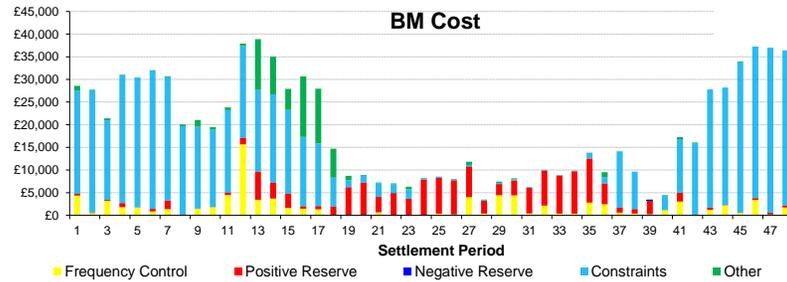


Daily Balancing Costs

BSUoS Charge Estimate: £1.80/MWh
Total Outturn: £2.56m

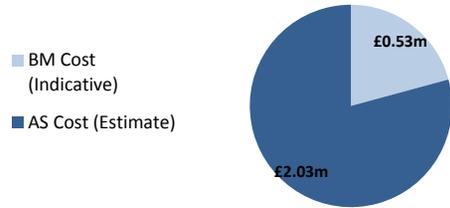

Commentary

200 MW of STOR was run for the darkness peak of the day. Trades were taken on the interconnectors for ROCOF in the early morning. Trades were taken for congestion in the North of Scotland. BM actions were taken for voltage control in Wales overnight and bids were taken for congestion in Scotland.