






Daily Balancing Costs

BSUoS Charge Estimate: £0.61/MWh
Total Outturn: £0.56m

BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR + BM Start Up)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM + AS General)

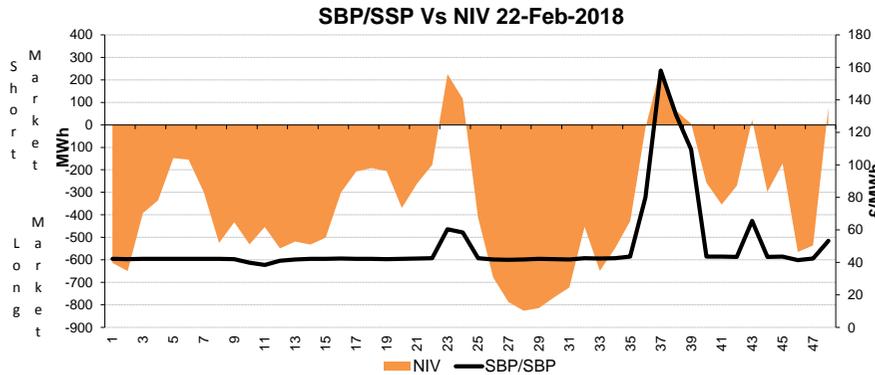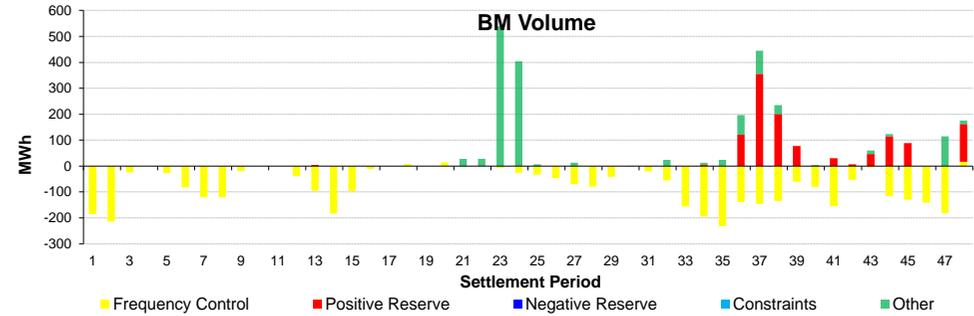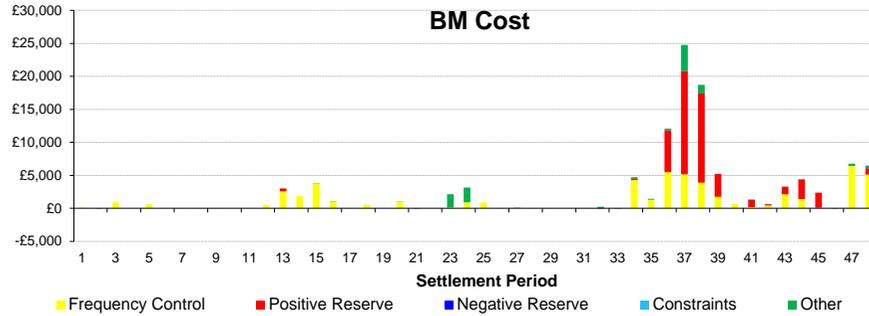

Commentary

No trades or BM system actions were required, plant requirement for voltage management was met by the market. Frequency dropped to 49.62Hz as a result of a trip on interconnector Bipole in the early morning. 749MW STOR was run over the evening peak.