
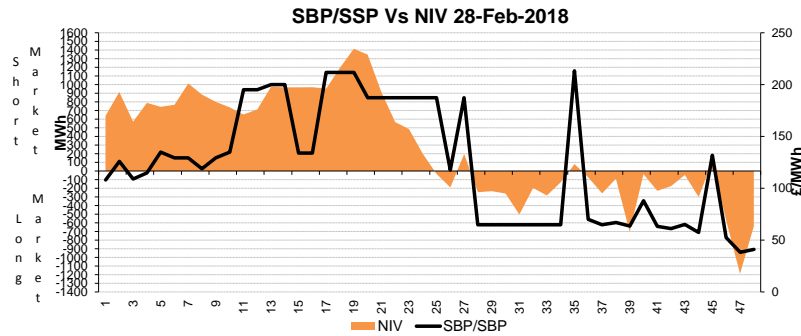
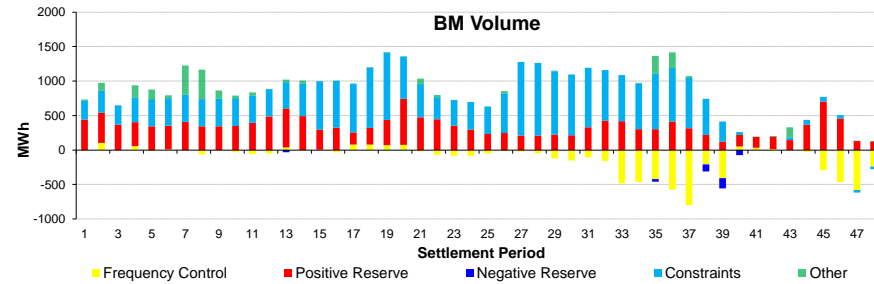
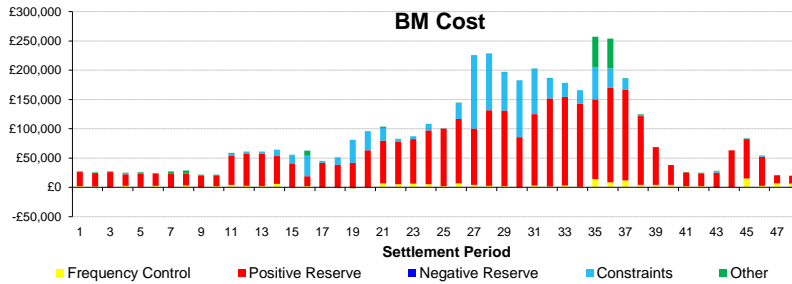
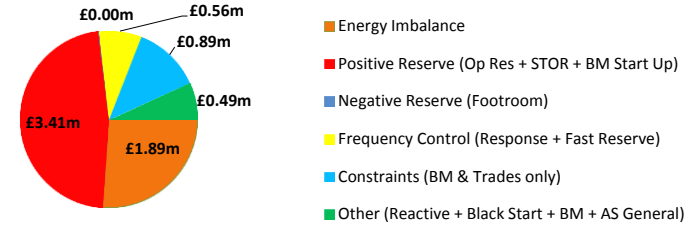


Daily Balancing Costs

BSUoS Charge Estimate: £3.95/MWh
Total Outturn: £7.24m

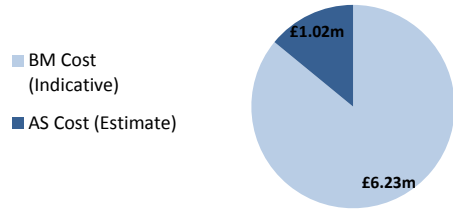

Commentary

500 MW of STOR was run in the early morning. During the morning pickup a number of gas fired plant failed to synchronise or reach their maximum output due to the cold temperatures (7 degrees colder than seasonal norm). As a result market was short by up to 3 GW leading to an increased cash out price. A significant volume of CCGT plant redeclared their availability down overnight until noon on Thursday. Eleven machines were bought on to secure the South East during high levels of demand and Export to France. Machines were also required to help with North - South power flow issues.