
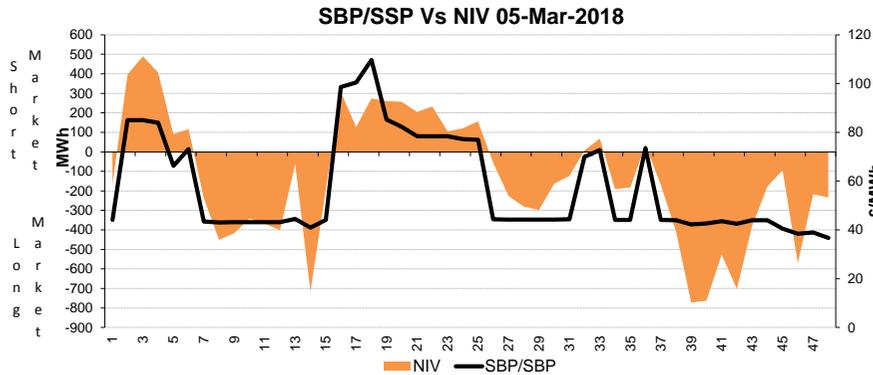
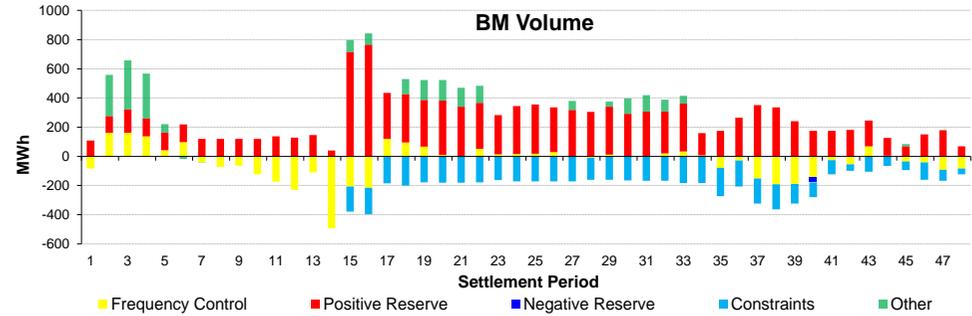
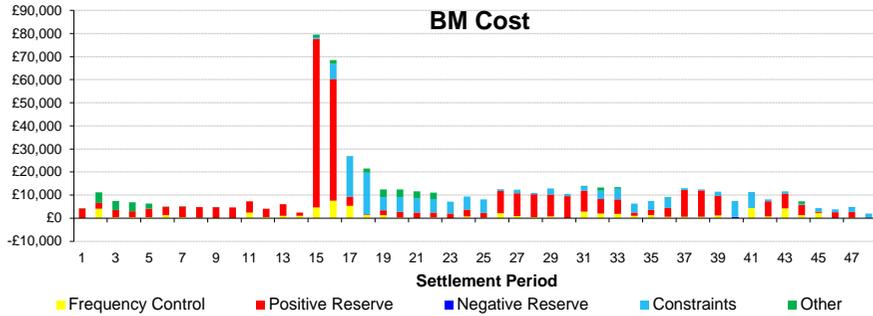
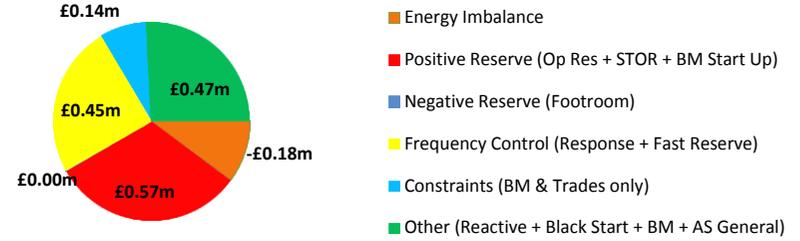


Daily Balancing Costs

BSUoS Charge Estimate: £1.05/MWh
 Total Outturn: £1.45m

BM Cost (Indicative)
 AS Cost (Estimate)



Commentary

During the Monday Morning pickup the wind was shortfalling up to 1200MW below forecast and with a local constraint in Wales causing restrictions, 400MW STOR was run. No trades were required for constraints, RocoF or Voltage control. BM actions were required on units in Wales throughout the day for a local constraint. Trades were carried out on the interconnectors for Margin in the morning; despite high prices being paid, this was more economical than buying machines in the BM due to the time period margin was required.