
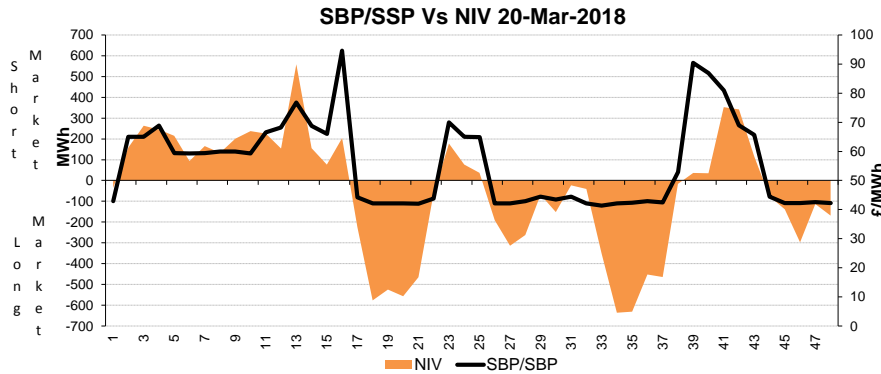
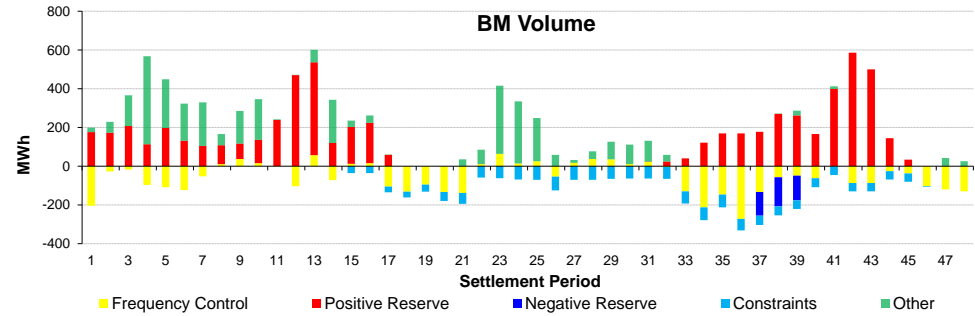
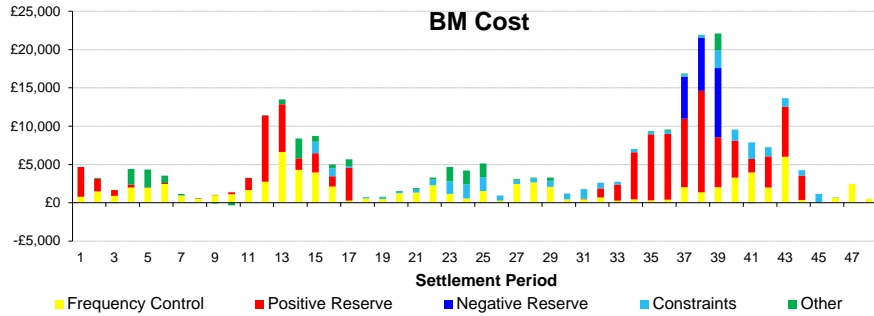
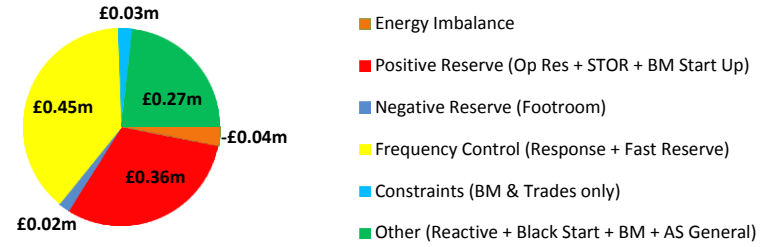


Daily Balancing Costs

BSUoS Charge Estimate: £0.88/MWh
Total Outturn: £1.09m

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

460MW of STOR was run for the morning peak and 350MW was utilised for the evening peak. Wind output remained low during the day. Trades were carried out on the Interconnectors for margin in the morning. No trades were required for RocoF, constraints or voltage control. BM actions were taken on 1 machine for a local constraint in the North of England. A small number of BM actions were also required throughout the day to manage a local constraint in Wales.