
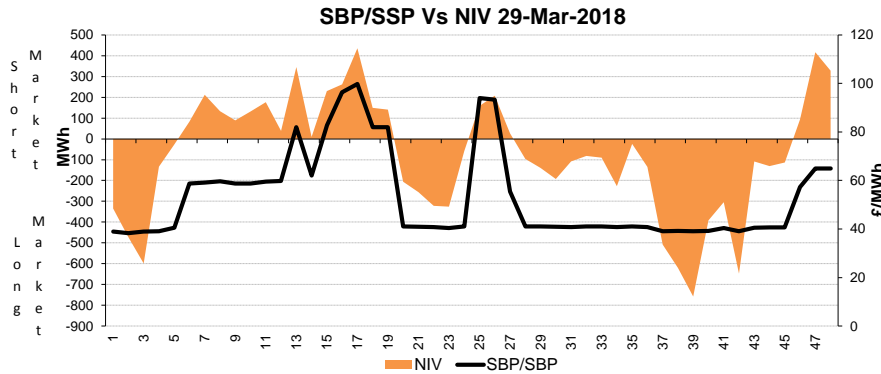
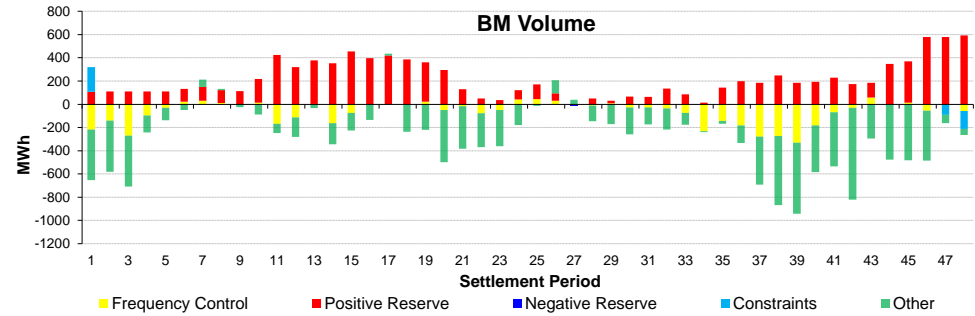
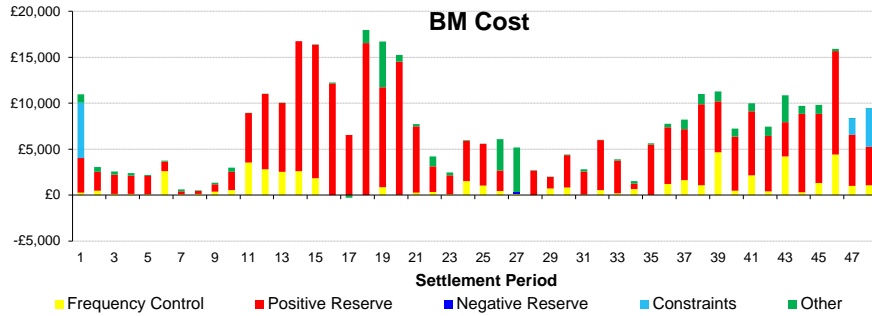
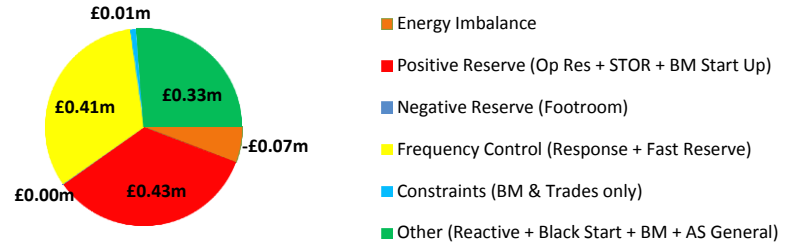


# Daily Balancing Costs

BSUoS Charge Estimate: £0.95/MWh  
Total Outturn: £1.10m

BM Cost (Indicative)  
AS Cost (Estimate)



## Commentary

250MW of STOR was run for the morning peak  
No trades were required for Rocof, voltage control or constraints. A small number of BM actions were taken to manage Rocof requirements in the early morning and again just before midnight in England.