
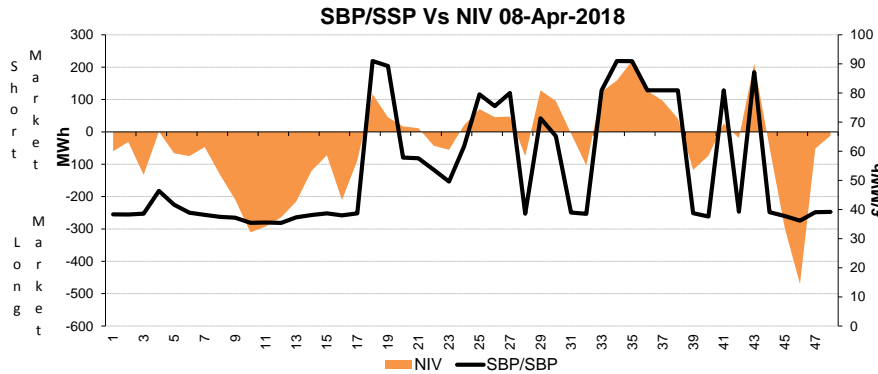
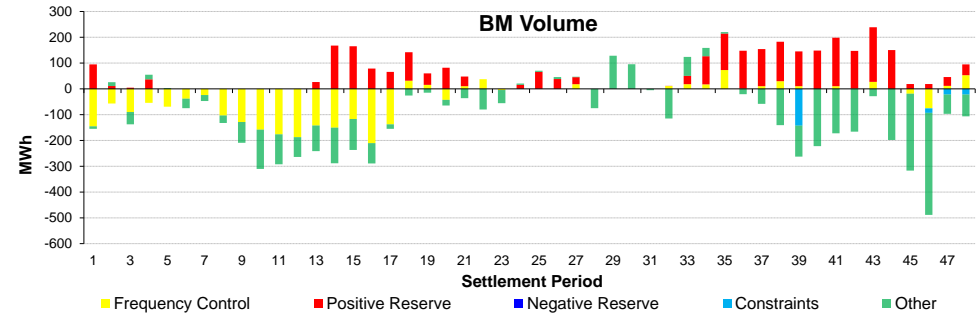
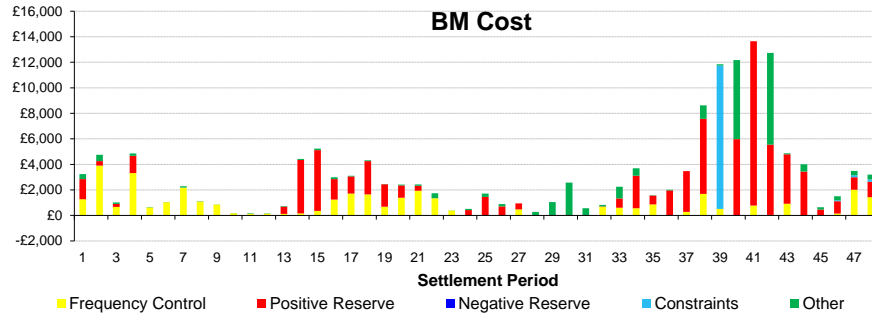
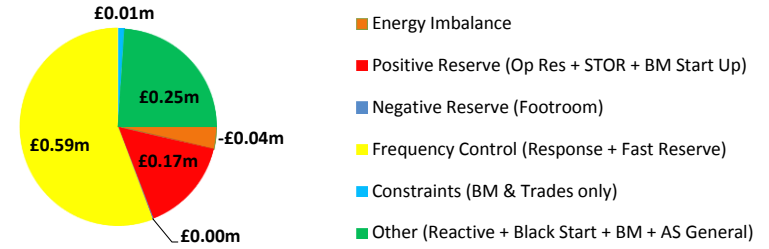


# Daily Balancing Costs

BSUoS Charge Estimate: £1.05/MWh  
Total Outturn: £0.98m

BM Cost (Indicative)  
AS Cost (Estimate)



## Commentary

The market was long overnight and prevalently short over the daylight hours. The wind level was very low throughout the day, as a result up to 500MW of STOR were required between the morning and the night. No trades were required for RocoF, voltage control or constraints. A small number of BM actions were taken to manage constrains following planned outages in the Wales area.