
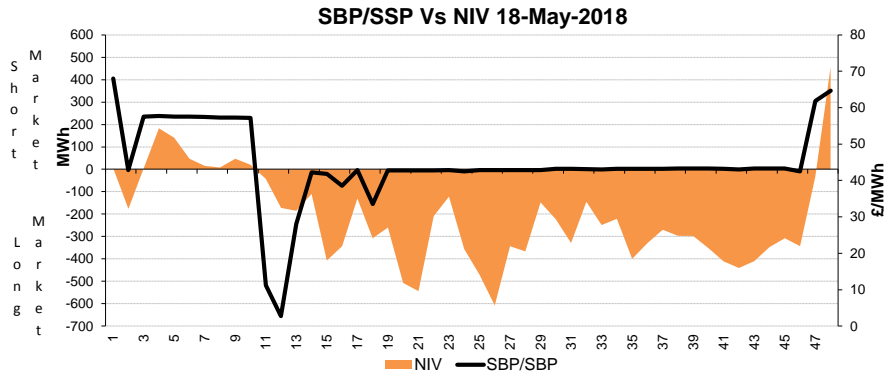
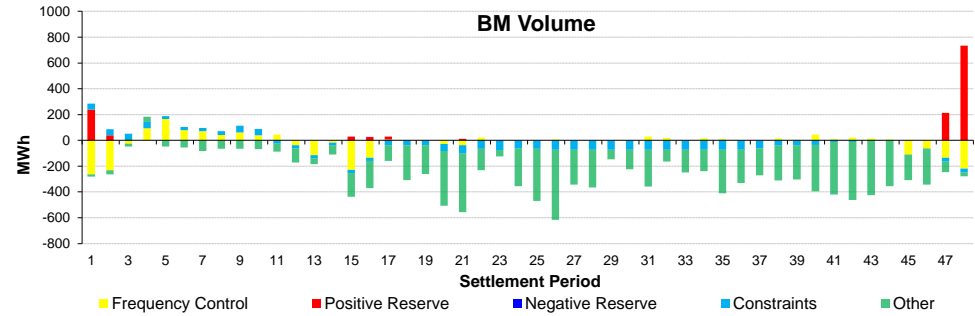
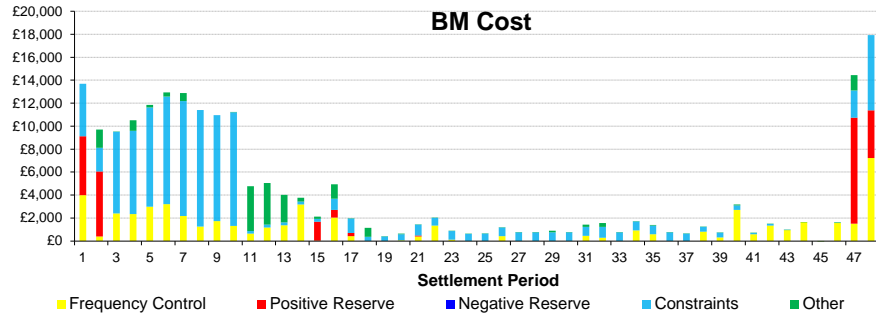
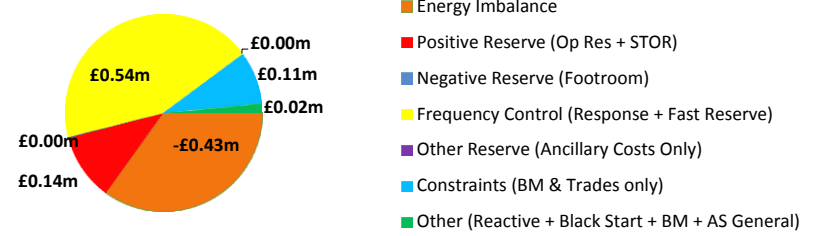


Daily Balancing Costs

BSUoS Charge Estimate: £0.89/MWh
Total Outturn: £0.58m

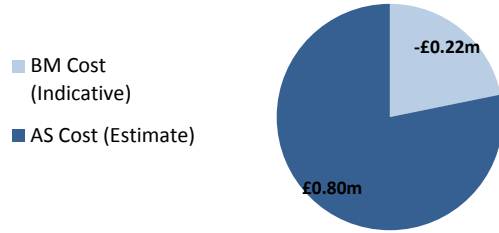

Commentary

450MW of High Response was held during the day for demand uncertainty. 295MW of STOR was run for the evening peak. Trades were carried out on the Interconnectors in the early morning and again just before midnight for ROCOF. Trades were also carried out for Voltage Control in Scotland. BM actions were taken for constraint in Wales.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.