
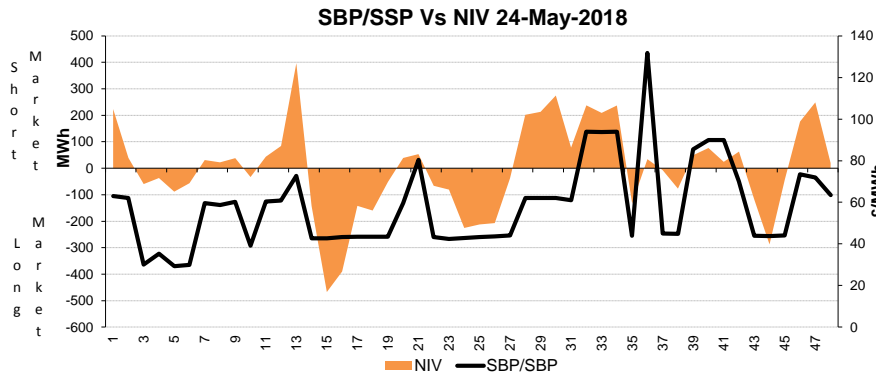
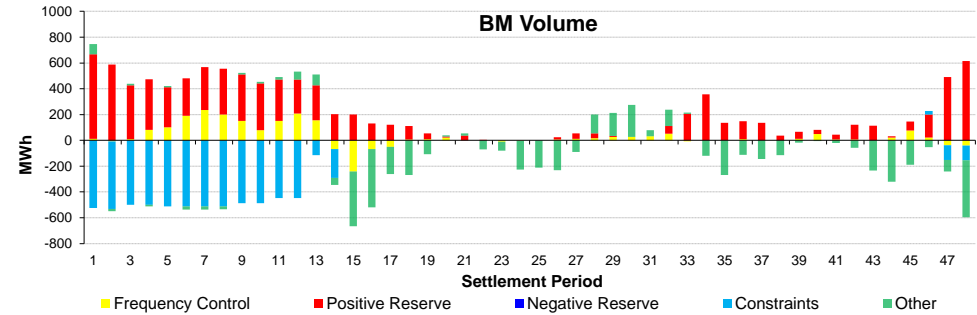
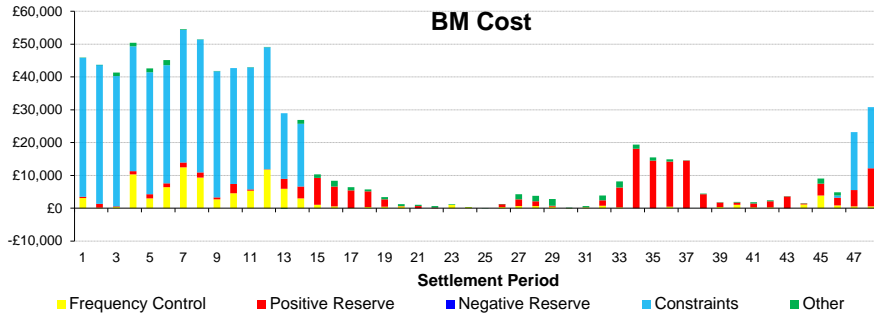
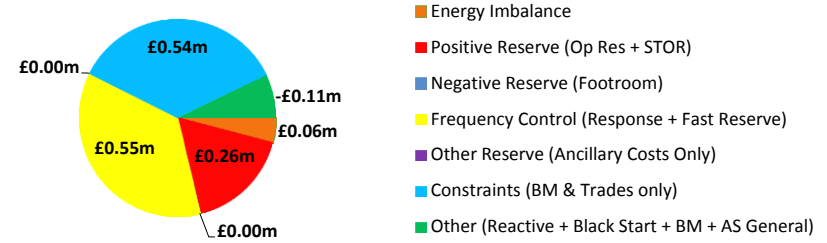


# Daily Balancing Costs

BSUoS Charge Estimate: £1.53/MWh  
 Total Outturn: £1.53m

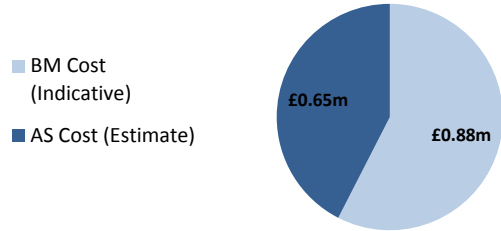

## Commentary

Just over 200MW of STOR ran for the morning peak. 550MW of High Response was held from 1700-1800hrs due to wind volatility and frequency performance risk. Trades were carried out on the Interconnectors and conventional generation for ROCOF in the early morning and again just before midnight. Trades were also carried out for Voltage control in the early morning in England and Wales. BM actions were taken just before midnight to manage Voltage control in Scotland.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.