






# Daily Balancing Costs

Date:

06/07/2018

BSUoS Charge Estimate: £1.53/MWh  
Total Outturn: £1.47m

BM Cost (Indicative)  
AS Cost (Estimate)

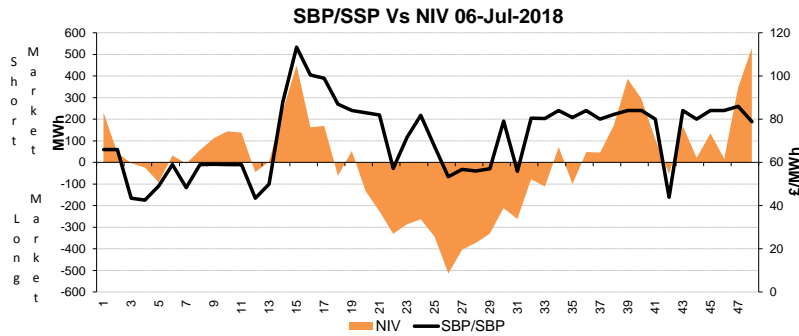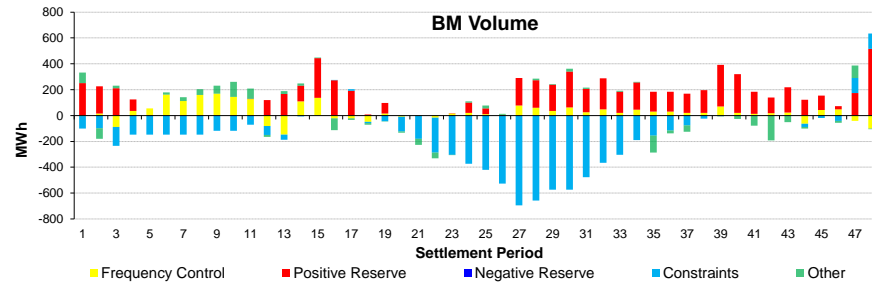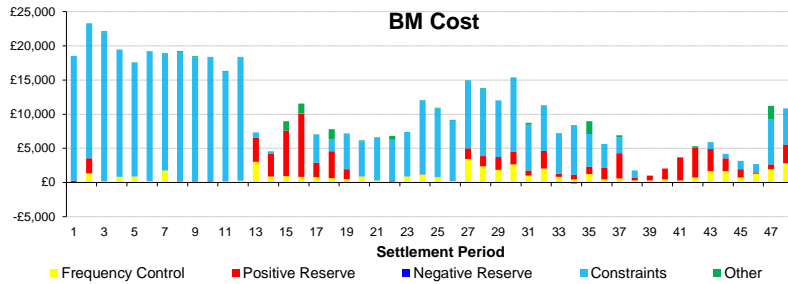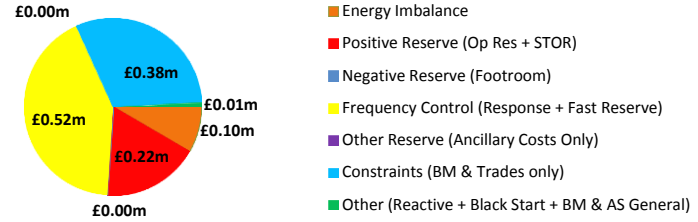

## Commentary

A number of plant losses and demand being up to 1GW above forecast required up to 850MW of STOR to be utilised throughout the morning and afternoon; additional HF response was also held for demand uncertainty. System issues in Wales, the South West and Midlands required a number of BM actions across numerous units. Trades were enacted to solve ROCOF and Voltage issues on interconnectors and BM units overnight.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.