
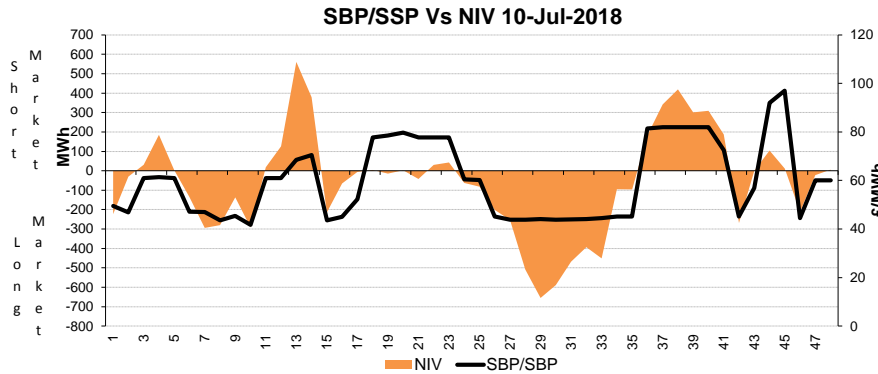
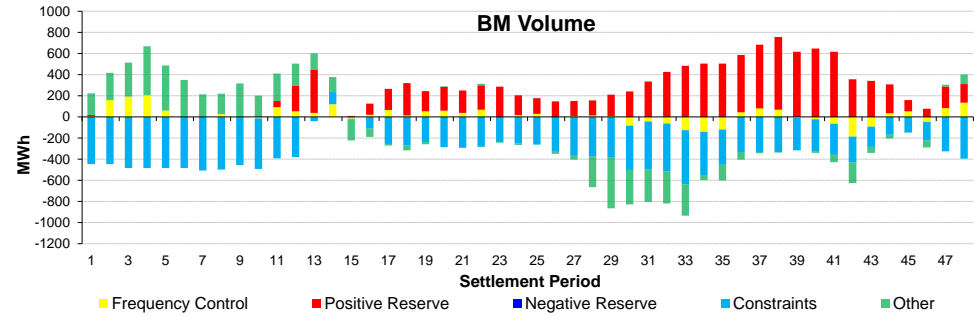
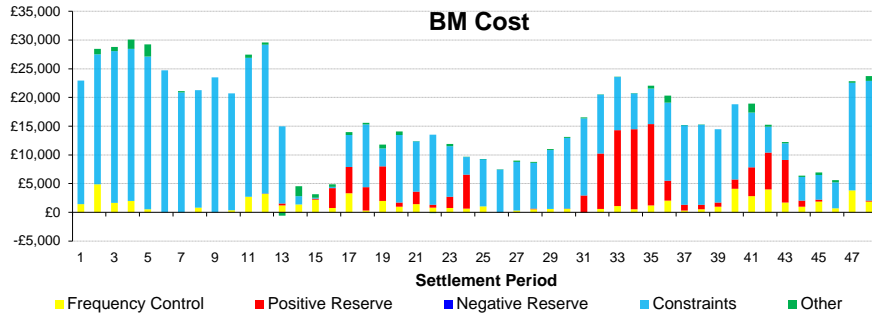
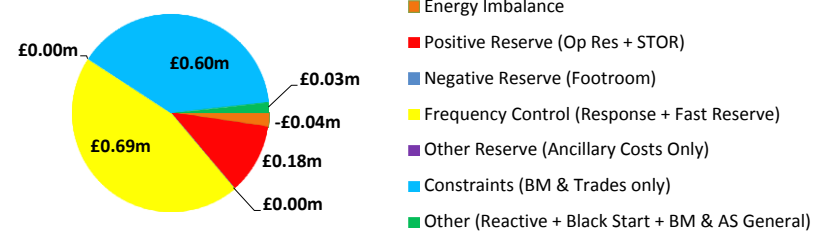


Daily Balancing Costs

BSUoS Charge Estimate: £1.70/MWh
 Total Outturn: £1.74m

■ BM Cost (Indicative)
 ■ AS Cost (Estimate)



Commentary

523MW of STOR was run in the evening. Additional dynamic response was also held in the evening to cover for France v Belgium World cup match. Trades were carried out on the Interconnectors and BM units for ROCOF. Trades were also carried out for voltage control in the North of England. Trades and BM actions were required for a constraint on the south coast.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.