
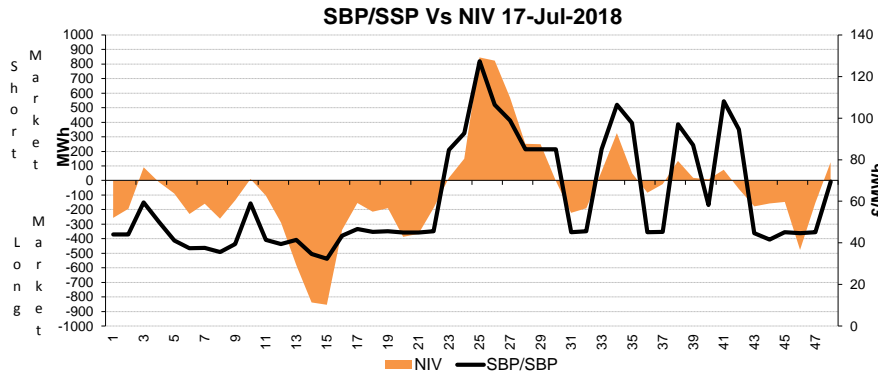
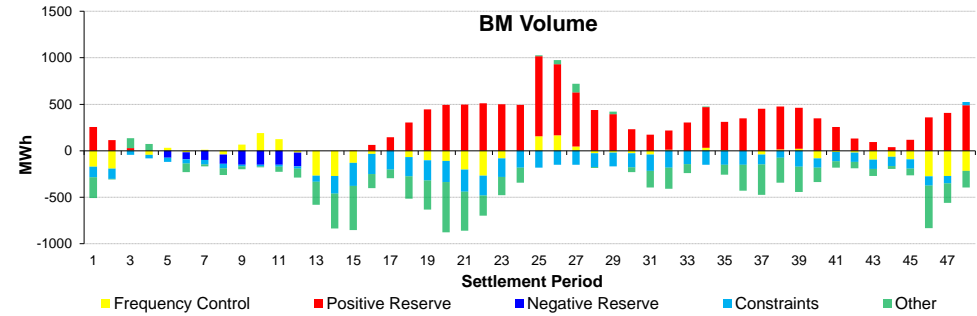
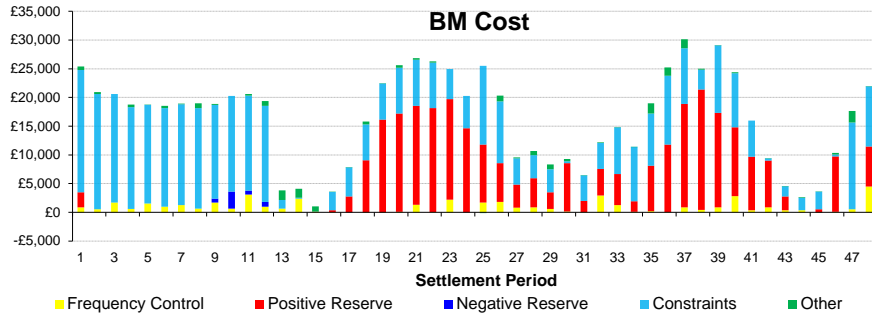
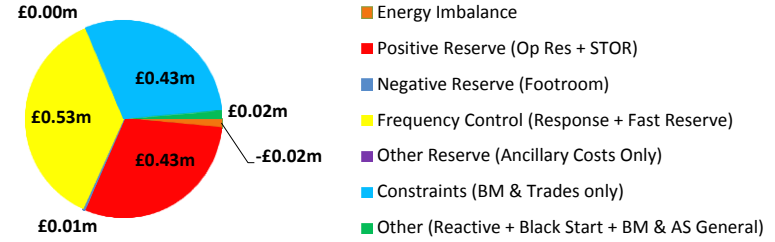


Daily Balancing Costs

BSUoS Charge Estimate: £1.62/MWh
Total Outturn: £1.65m

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

400MW STOR was run late morning after demand out turned higher than forecast. Trades were carried out on the Interconnectors and conventional units for ROCOF. Trades and BM actions were required for Voltage control in the North of England and for constraints in the South East.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.