
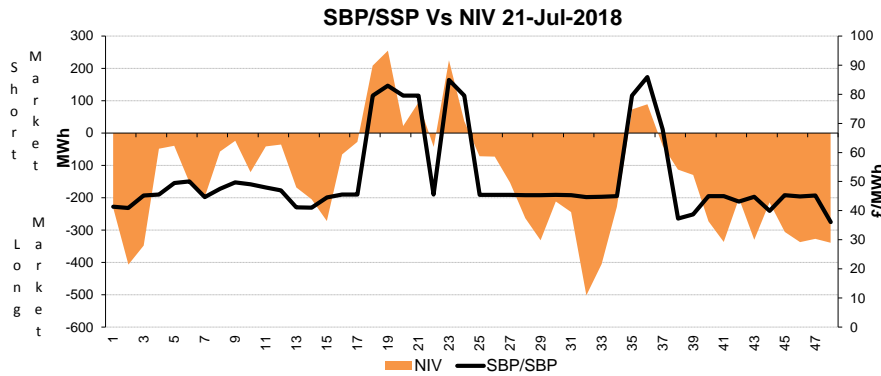
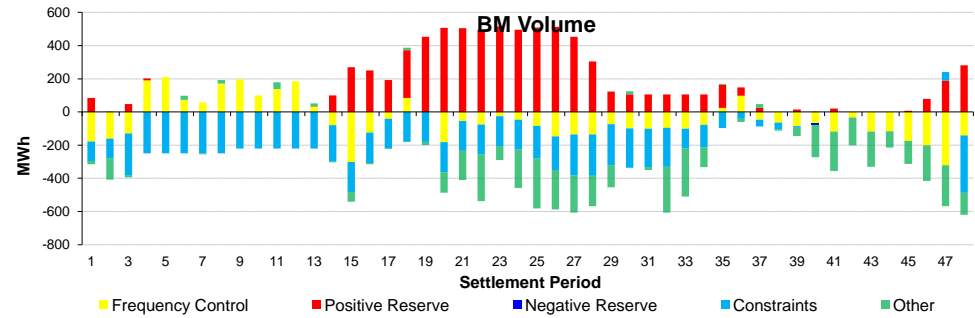
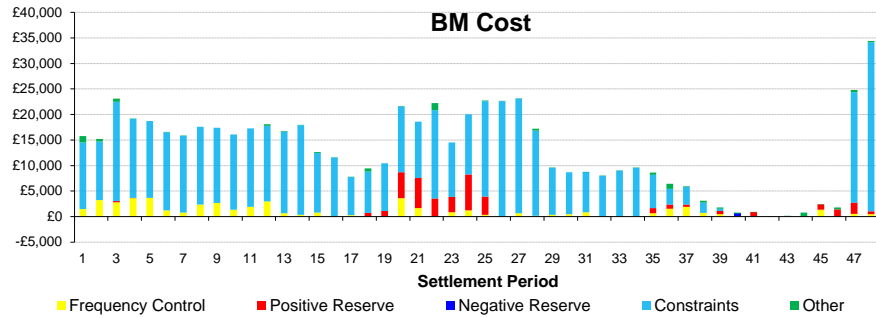
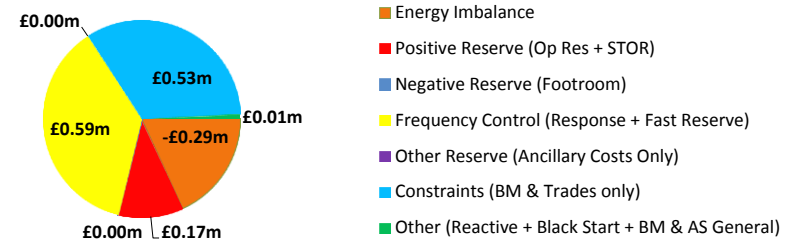


Daily Balancing Costs

BSUoS Charge Estimate: £1.51/MWh
Total Outturn: £1.20m

■ BM Cost (Indicative)
■ AS Cost (Estimate)



Commentary

STOR was utilised between 17:00 and 22:30 with a volume between 330MW and 430MW. Trades were used to solve the constraint in the South East, with additional trades for ROCOF and voltage. A circuit fault in the South West created a local constraint which was resolved through bids in the BM.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.