
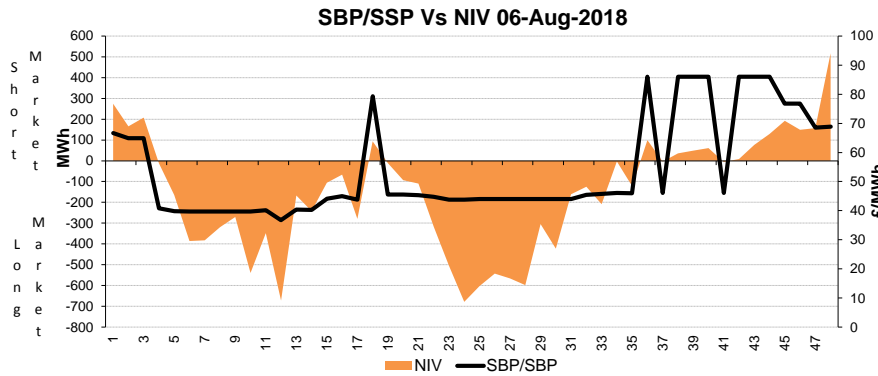
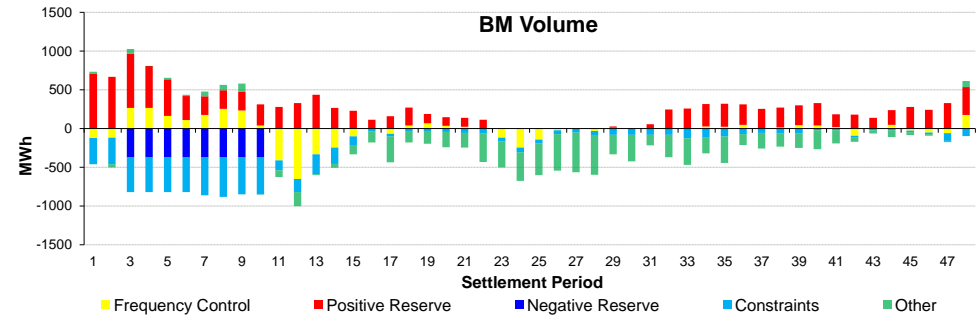
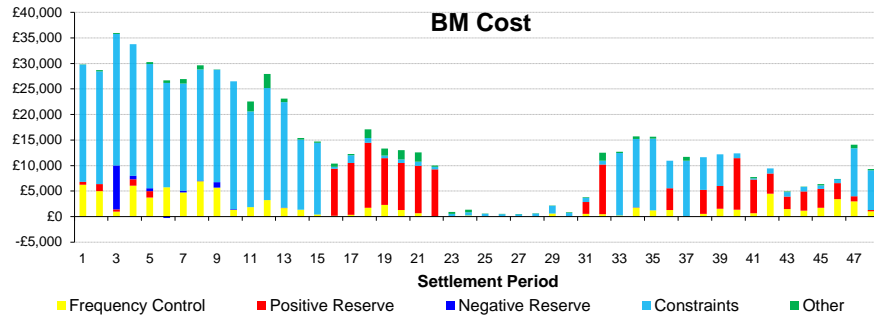
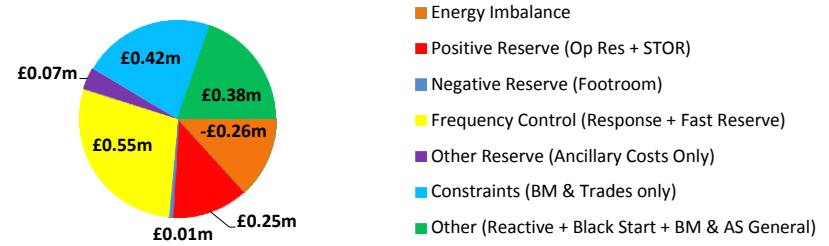


Daily Balancing Costs

BSUoS Charge Estimate: £1.54/MWh
Total Outturn: £1.43m

■ BM Cost (Indicative)
■ AS Cost (Estimate)



Commentary

The market is generally long during the day. Additional response was held in the evening to cover for demand uncertainty. There is still a constraint in South Wales that require BM actions. Voltage control was still active for a machine in the north and on the interconnectors.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.