
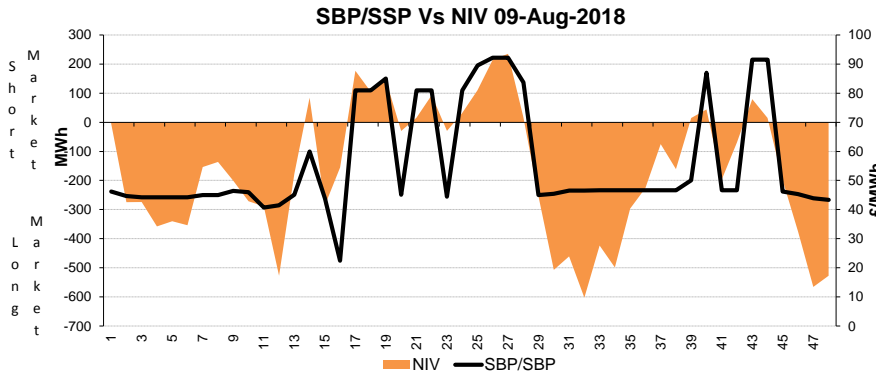
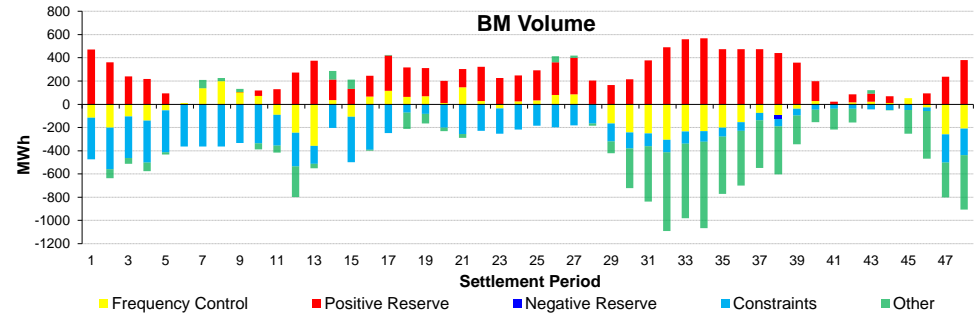
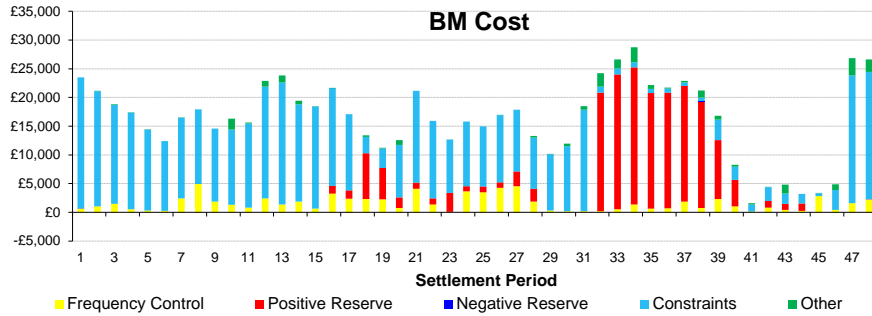
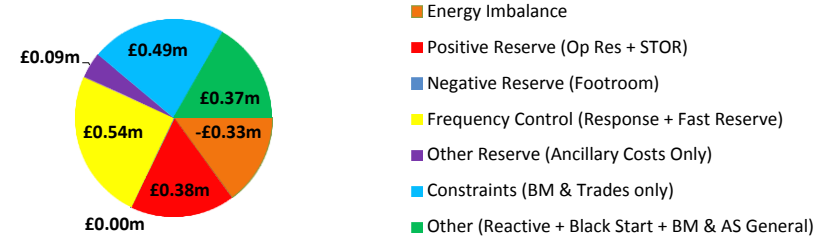


# Daily Balancing Costs

BSUoS Charge Estimate: £1.59/MWh  
Total Outturn: £1.55m

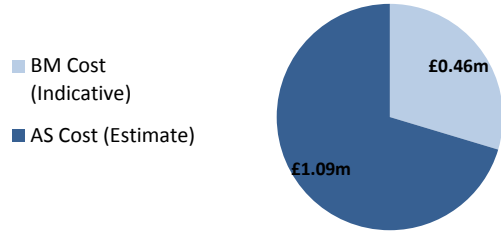

## Commentary

Up to 300MW of STOR was run in the morning to cover for generation shortfall. A constraint in South Wales continues to require BM actions to solve throughout the day. ROCOF issues were experienced in the morning and just before midnight were resolved via trades on interconnectors and a BM unit; some additional BM actions were required late morning. Trades were also carried out for voltage control in the South East and Wales. A small volume of BM actions were required for a constraint in North England.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.