
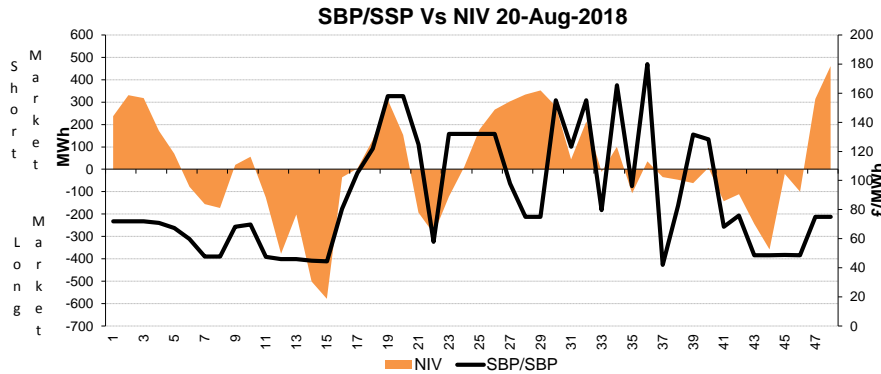
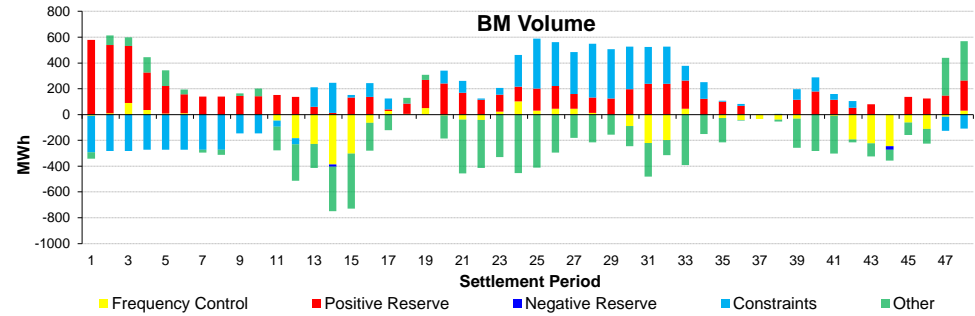
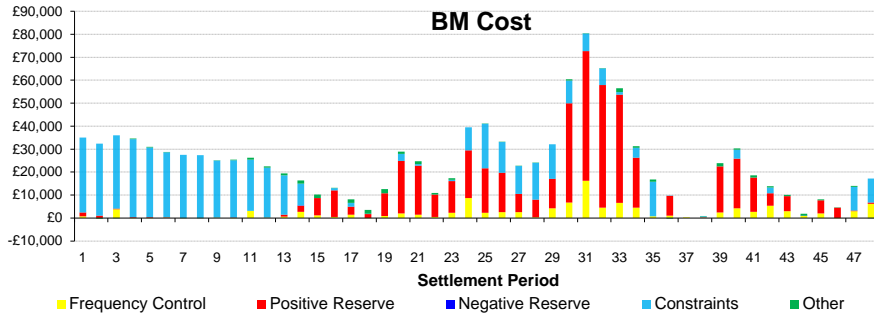
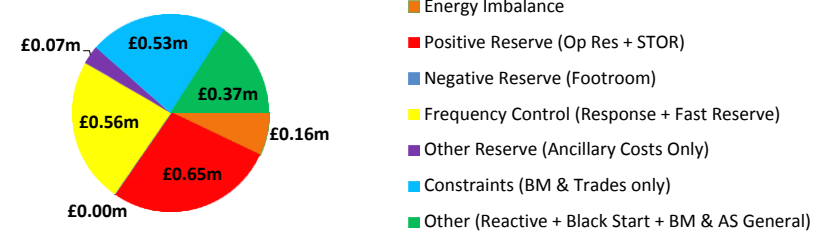


Daily Balancing Costs

BSUoS Charge Estimate: £2.00/MWh
 Total Outturn: £2.34m

BM Cost (Indicative)
 AS Cost (Estimate)



Commentary

STOR was run throughout the day to cover for demand forecast error. ROCOF issues were experienced overnight and trades were used to resolve on the interconnectors and a BM unit. Trades were also required on one machine to manage voltage control in the North West. A constraint in North England required offers on wind and water units to solve across most of the day.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.