
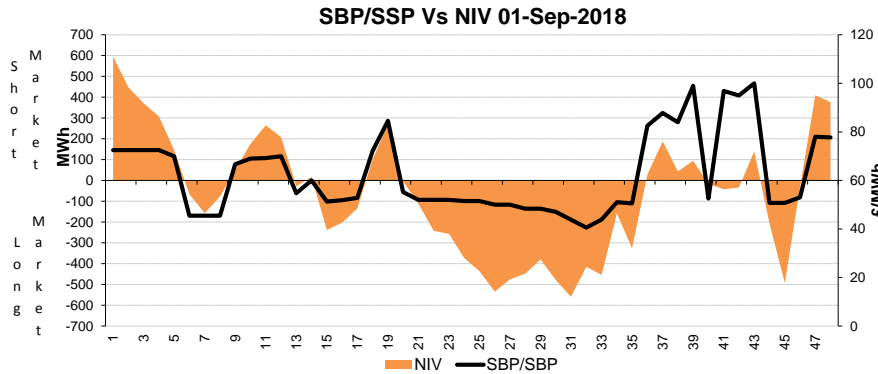
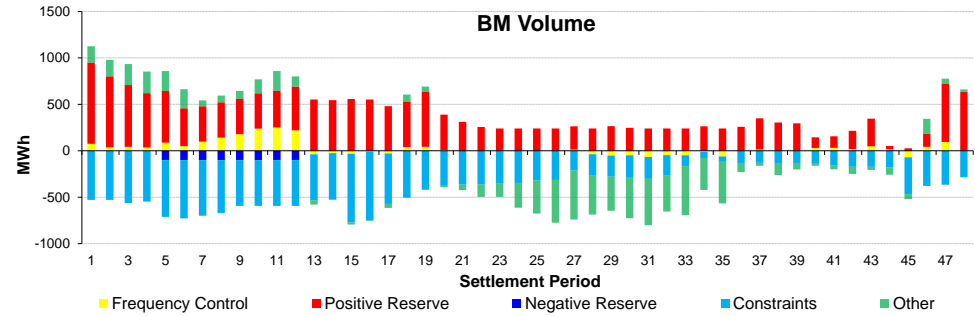
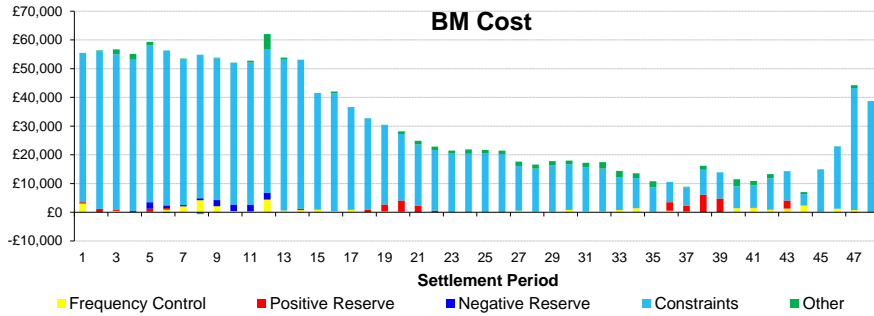
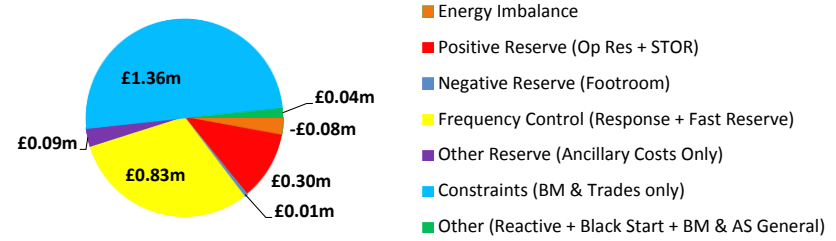


Daily Balancing Costs

BSUoS Charge Estimate: £2.58/MWh
Total Outturn: £2.56m

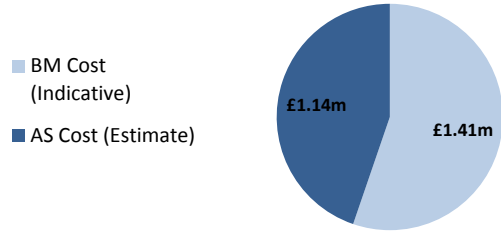

Commentary

196 MW of STOR was run in the early evening due to demand error. RocoF issues were resolved during the night and during the day by trading on the interconnectors and on a generator in the north. BM actions were taken overnight to assist with a constraint in the North. BM actions were also taken in Wales for a constraint. Trading was taken overnight for voltage control in the north west.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.