






Date: 24/09/2018

BSUoS Charge Estimate: £1.69/MWh
Total Outturn: £1.90m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

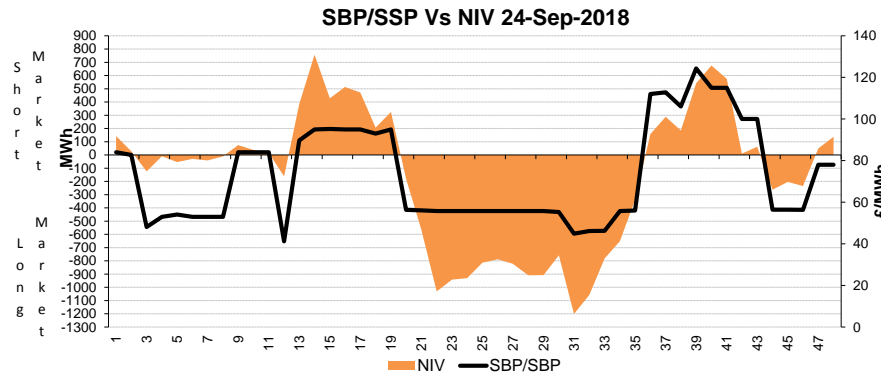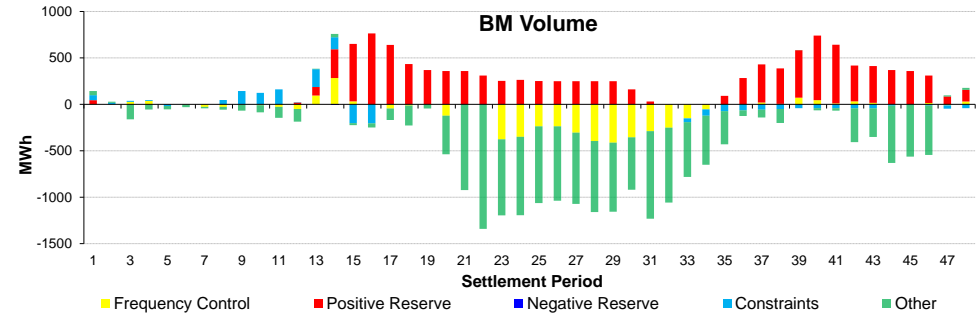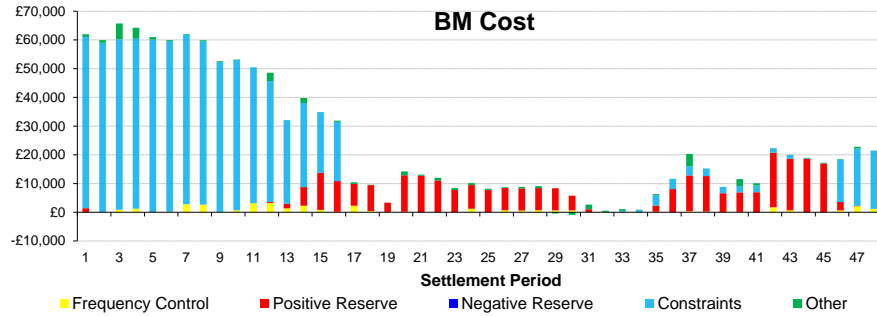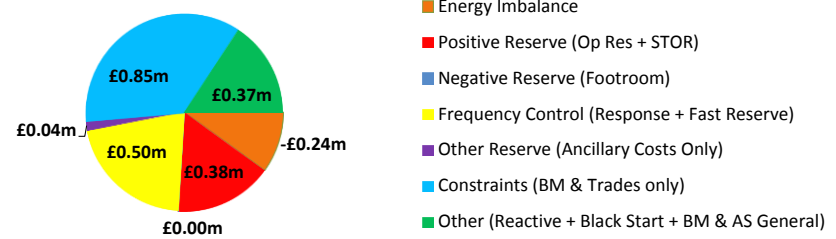

Commentary

600 MW of STOR was run in the early hours. A constraint in the North of England was resolved via bids and trades. Trades and BM actions were used to solve voltage requirements in the Midlands the North West and in the South East and Wales. Rocof issues were resolved via trades on the interconnectors and a generator unit overnight.

Note: A new category - Other Reserve - has been more clearly defined. Costs in this category used to be mapped to either Positive Reserve or Fast Reserve. These costs include BM Startup, Fast Start and some Hydro services. These changes have been made to align with the new Monthly Balancing Services Summary report.