
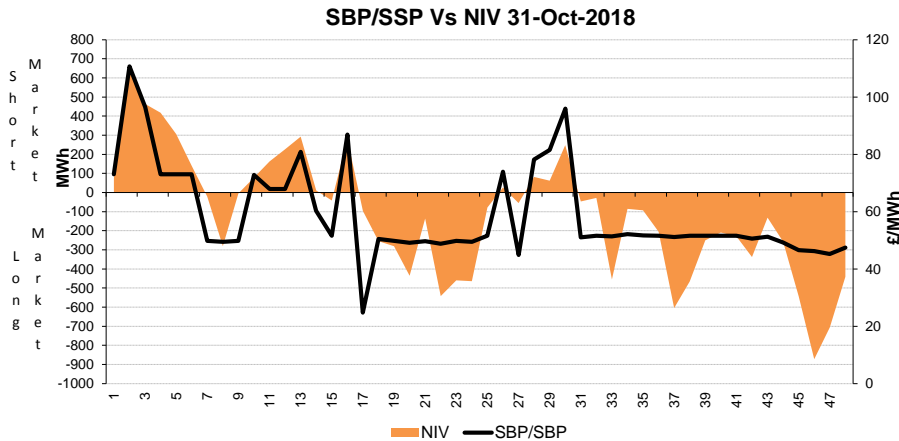
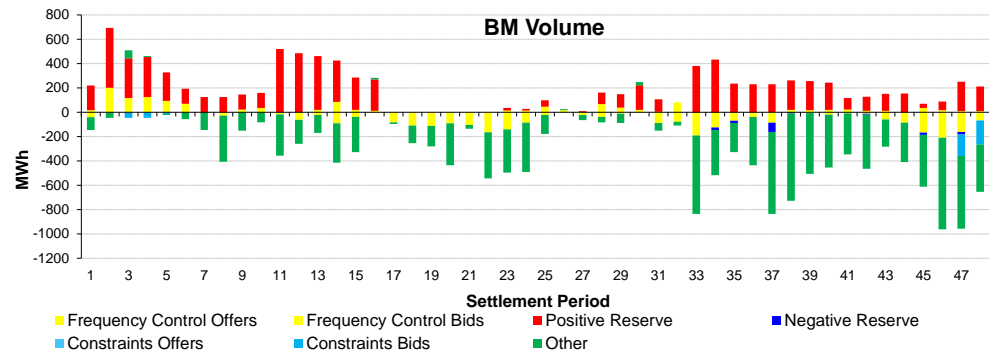
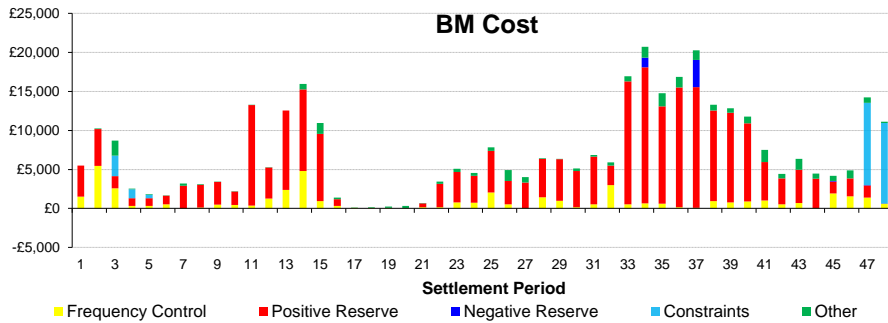
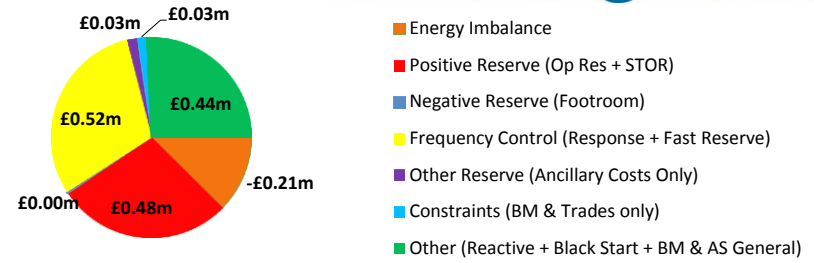


Date: 31/10/2018

BSUoS Charge Estimate: £1.06/MWh  
Total Outturn: £1.29m

# Daily Balancing Costs

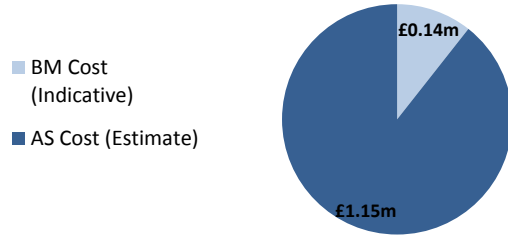

## Commentary

200MW of STOR was run for the morning pick up to cover for plant shortfall. Trades were taken on the Interconnectors over the morning and evening peaks for positive margin. Additional response was held throughout the day for demand uncertainty and general frequency performance risk. Trades were carried out on the Interconnectors and BM actions were taken for ROCOF overnight. No system actions were required for voltage control.

**Western Link Status: Available**