






Date: 08/11/2018

BSUoS Charge Estimate: £1.84/MWh
Total Outturn: £2.47m

Daily Balancing Costs



■ BM Cost (Indicative)
■ AS Cost (Estimate)

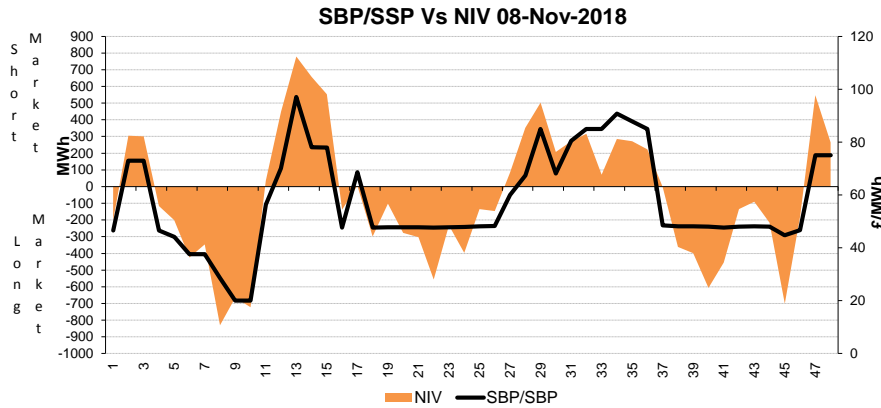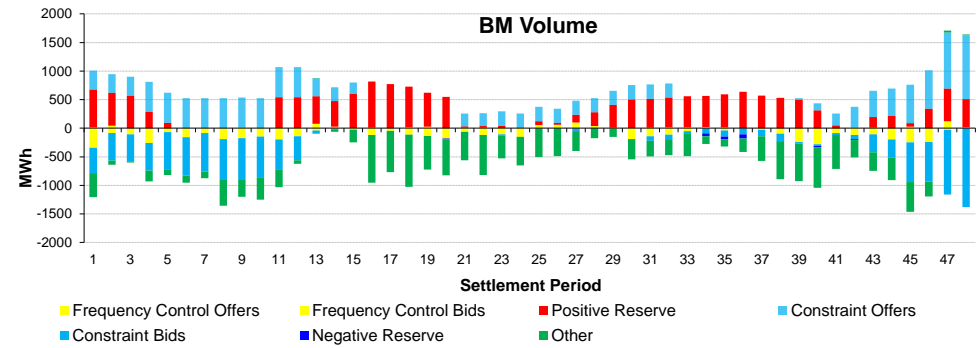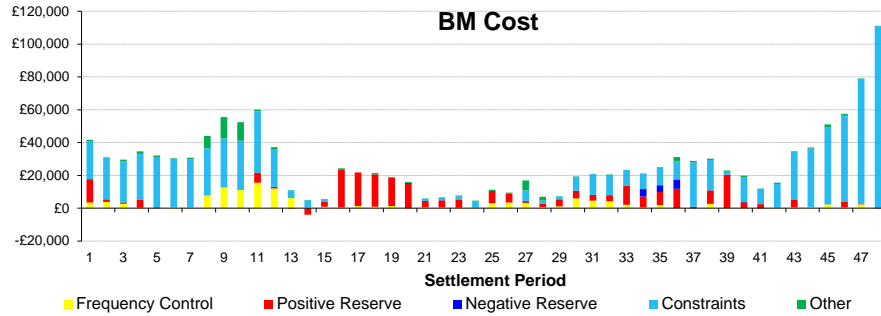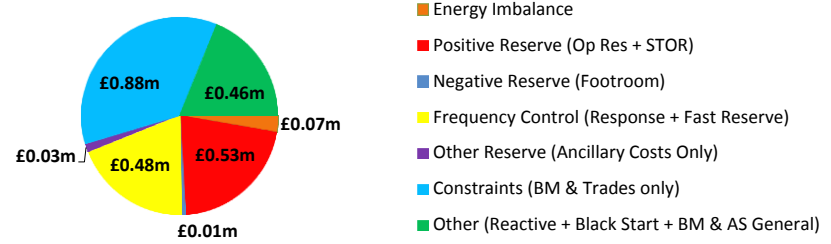

Western Link status: Available

Commentary

Additional high response was held throughout the morning to cover for general frequency performance risk and in the late evening to cover for wind volatility. ROCOF issues were solved via trades on the Interconnectors and a BM unit in addition to a small number of BM actions. Trades and BM actions were taken to solve power flow restrictions due to planned outages in North of Scotland and on the network boundary between England and Scotland. Trades were taken on the Interconnectors to manage a constraint in the South East. Overnight the voltage levels were regulated with a mix of trades and BM actions.