
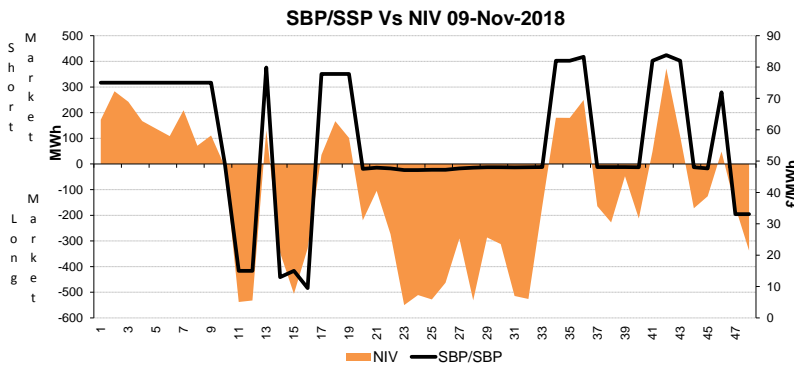
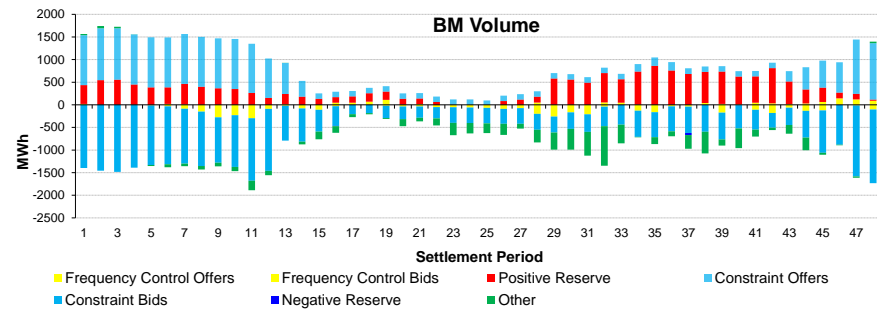
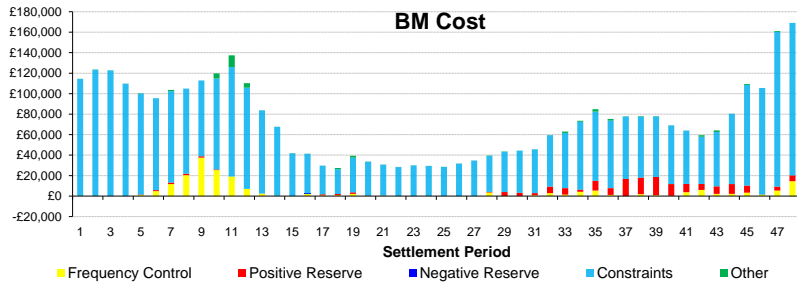
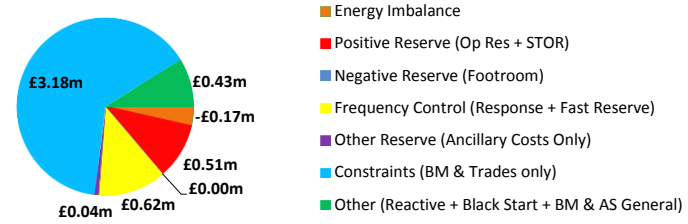


Date: 09/11/2018

BSUoS Charge Estimate: £3.23/MWh
Total Outturn: £4.60m

Daily Balancing Costs

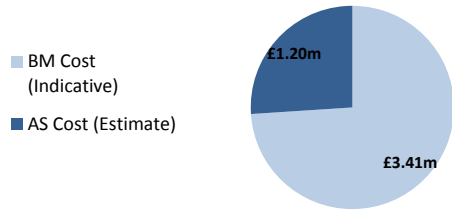

Commentary

Trades were carried out on the Interconnectors in the early afternoon for positive reserve. Additional high response was held for a short time in the morning. ROCOF issues were solved via trades on the Interconnectors and BM units in addition to a small number of BM actions. Trades were taken to solve power flow restrictions due to planned outages in North of Scotland and on the network boundary between England and Scotland. Overnight the voltage levels were regulated with a mix of trades and BM actions.

Western Link status: Available