






Date: 19/11/2018

BSUoS Charge Estimate: £1.18/MWh
Total Outturn: £1.49m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

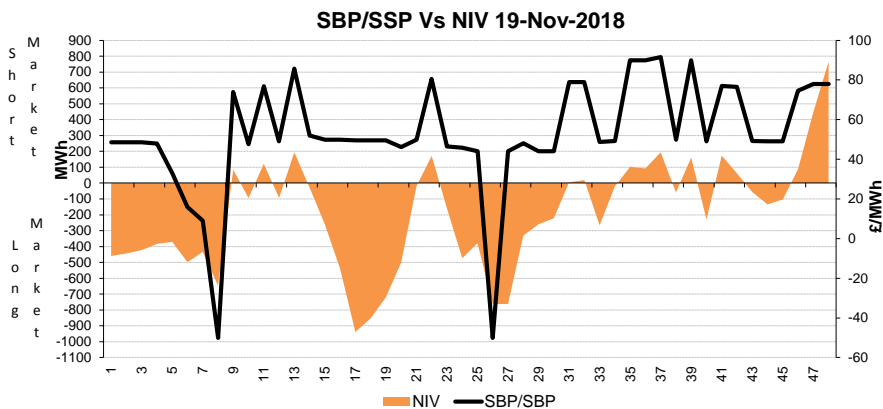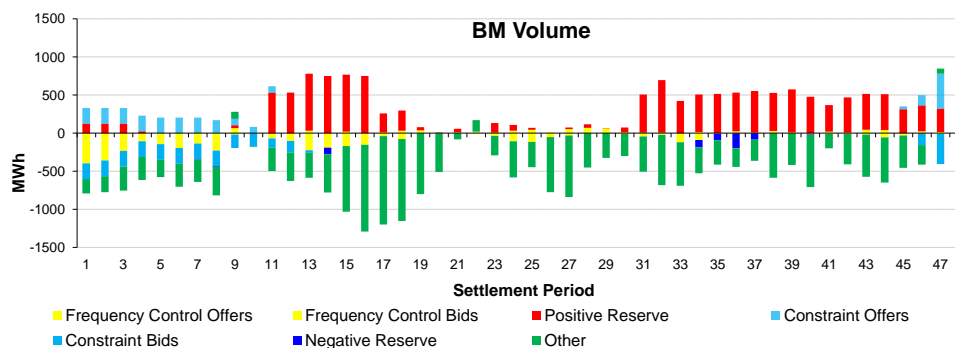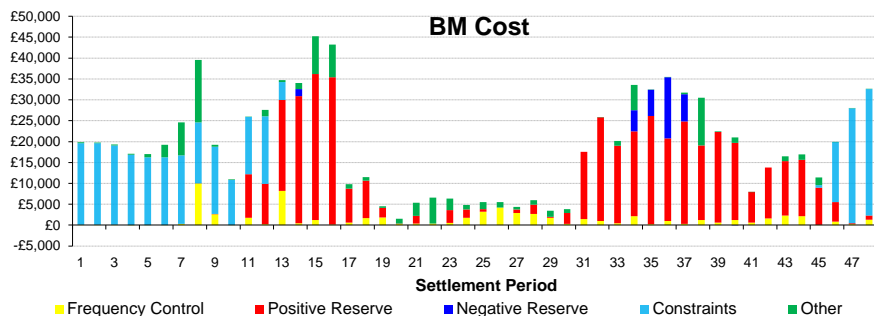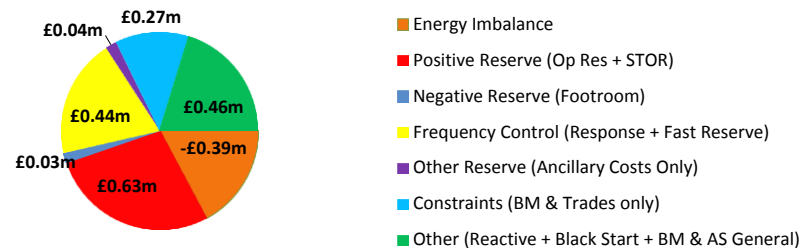

Western Link status: Available

Commentary

Additional high response was held in the early morning to cover for wind volatility. Trades were carried out on the Interconnectors for positive reserve over the morning peak. Negative bid prices were required to be accepted for energy reasons, and these contributed to negative cash out prices during the day. RocoF issues were solved via trades on the interconnectors and on a BM unit in addition to a small number of BM actions. A mix of Trades and BM actions were required to manage voltage levels in the South East, North West, Wales and Scotland. There were no thermal constraint issues.