
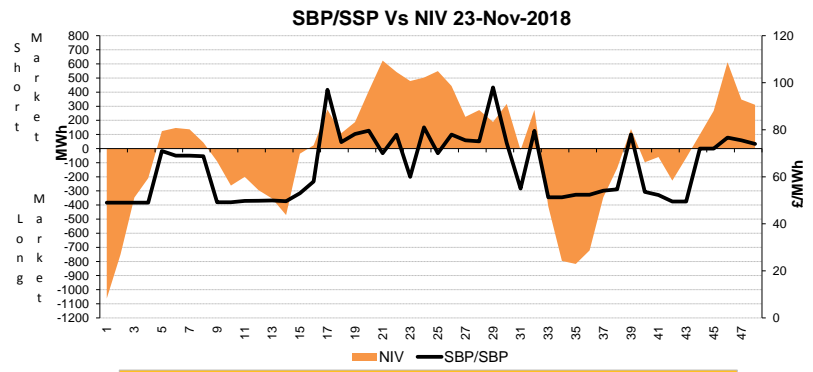
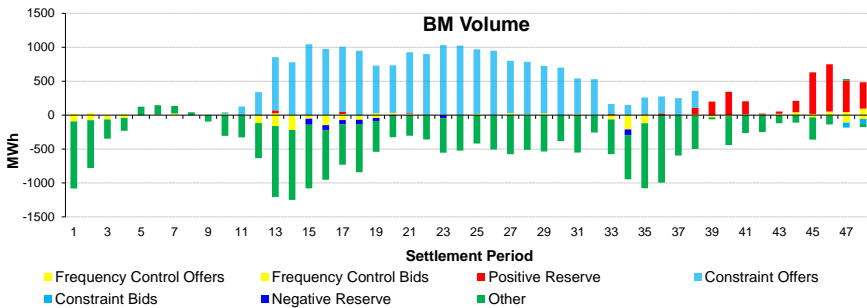
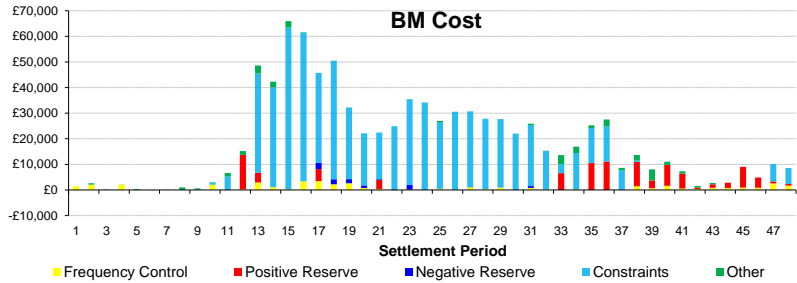
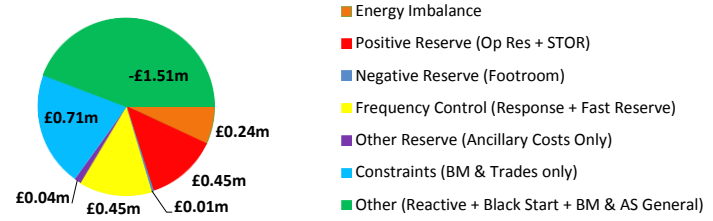


Date: 23/11/2018

BSUoS Charge Estimate: £0.51/MWh  
Total Outturn: £0.39m

# Daily Balancing Costs

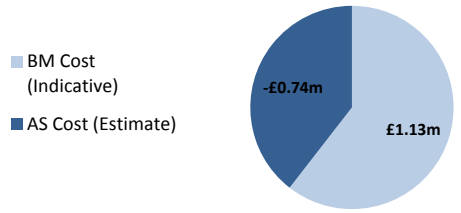

## Commentary

Trades were carried out on the Interconnectors for positive reserve over the morning peak. A large number of trades were carried out on the Interconnectors for a South East constraint to reduce exports to Continental Europe through the day in addition to small number of BM actions in the morning. Due to low wind generation all plant requirements for voltage management were met by the market, ROCOF issues were solved via trades.

**Western Link status: Available**