
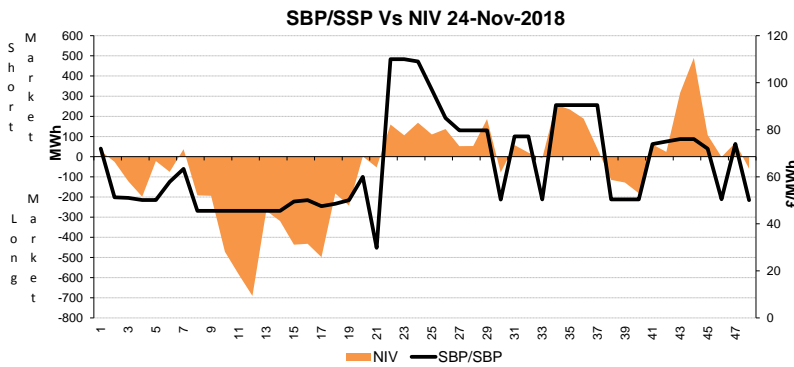
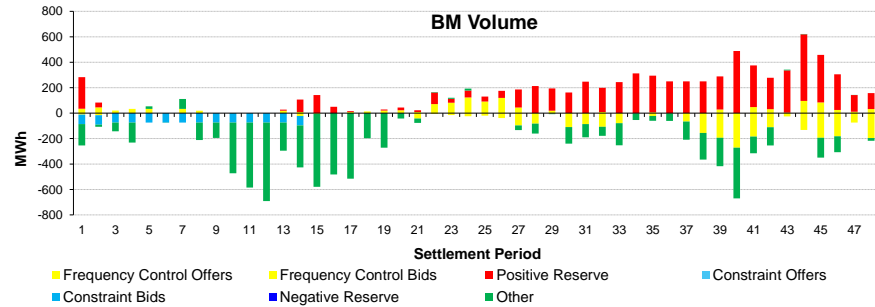
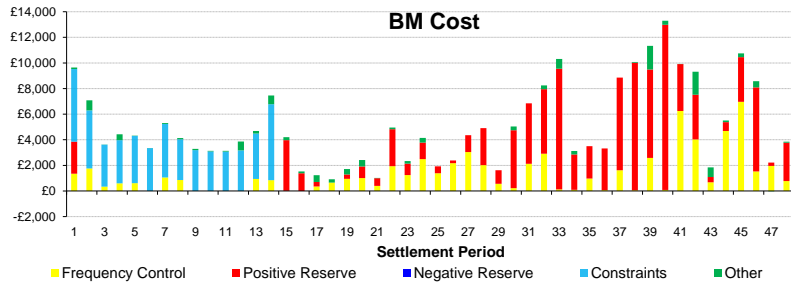
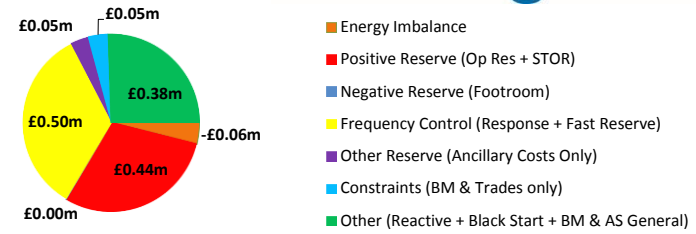


Date: 24/11/2018

BSUoS Charge Estimate: £1.16/MWh
Total Outturn: £1.37m

Daily Balancing Costs

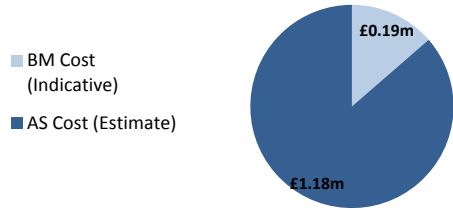

Commentary

Additional high response was held through the morning due to demand uncertainty. System was long through the overnight and morning but tightened through the afternoon and evening peak. ROCOF issues were solved via trades. Voltage requirements were met by the market due to low wind generation. No Interconnector trades were carried out.

Western Link status: Available