






Date: 30/11/2018

BSUoS Charge Estimate: £4.31/MWh  
Total Outturn: £6.50m

# Daily Balancing Costs



BM Cost (Indicative)  
AS Cost (Estimate)

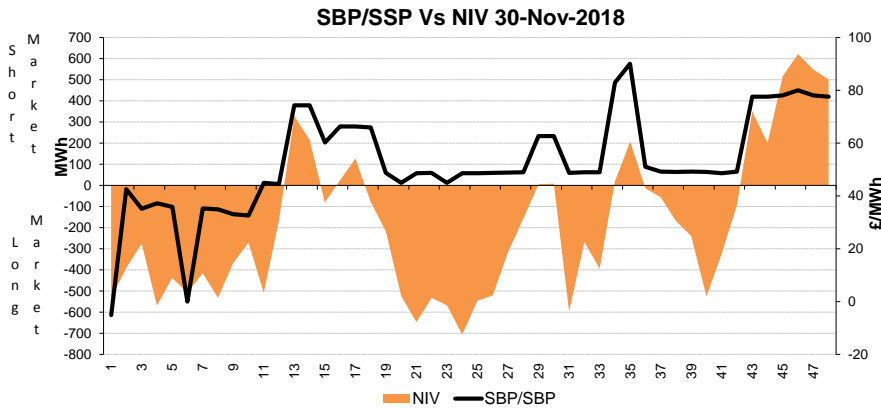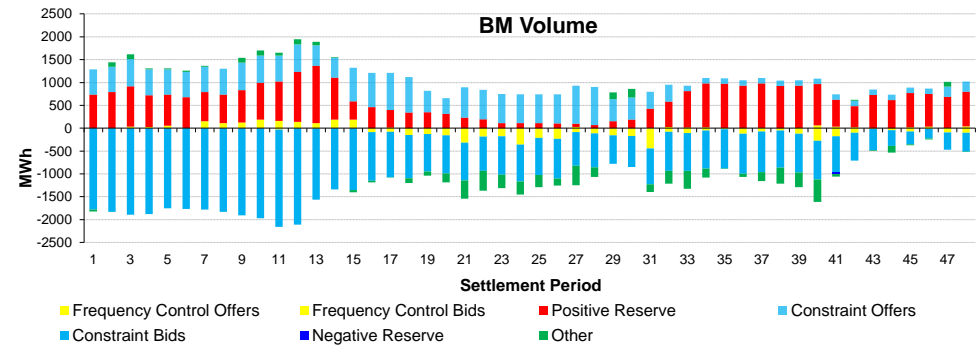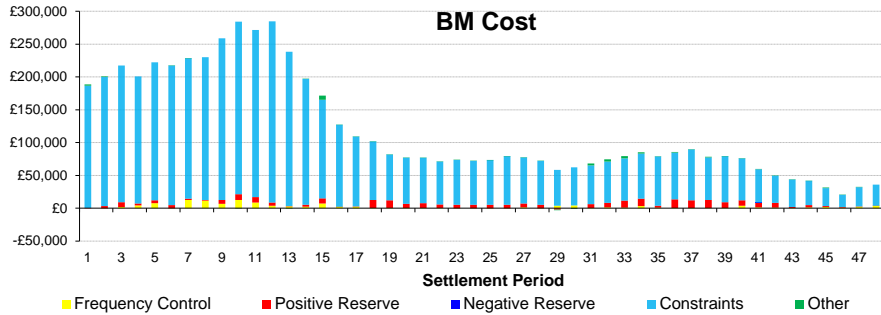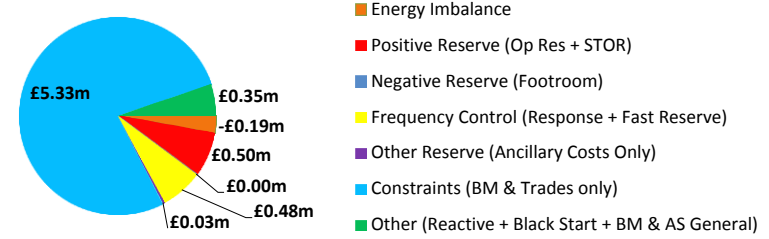

**Western Link status: Available**

## Commentary

Additional response was held from the afternoon onwards. ROCOF was resolved via trades on the Interconnectors and on a BM unit. Trades and BM actions were required to manage a constraint in the North of Scotland in addition to BM actions on wind and water to manage power flow restrictions on the network boundary between Scotland and England. Trades and BM actions were required to manage constraint issues in the South East. Trades and BM actions were required overnight to manage voltage support in the Midlands, North East, South East, South Wales and Scotland.