
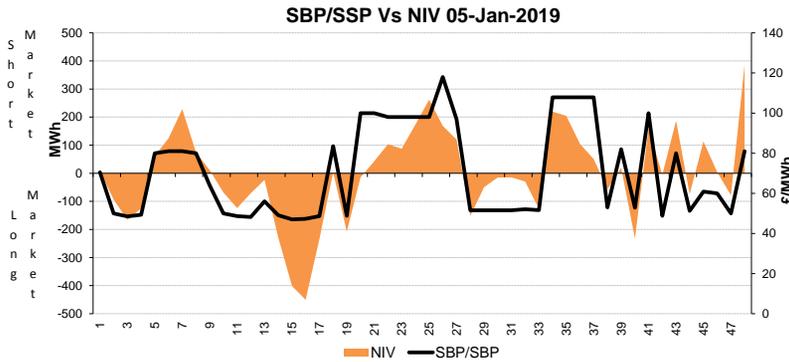
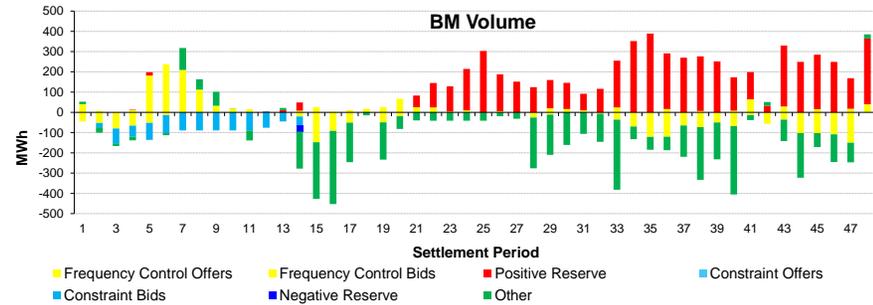
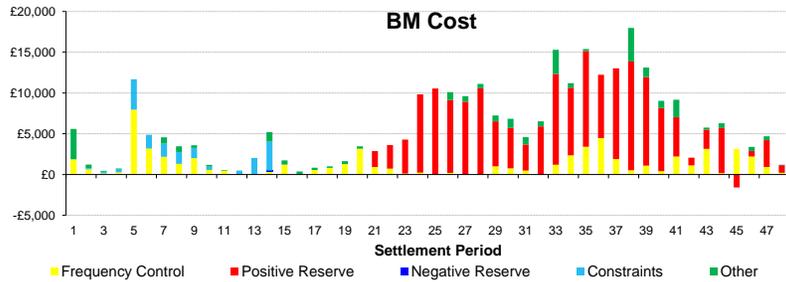
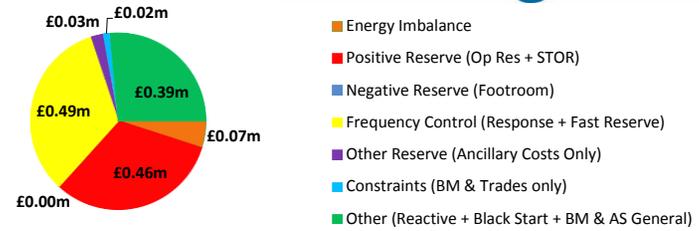


Date: 05/01/2019

BSUoS Charge Estimate: £1.17/MWh  
Total Outturn: £1.46m

# Daily Balancing Costs

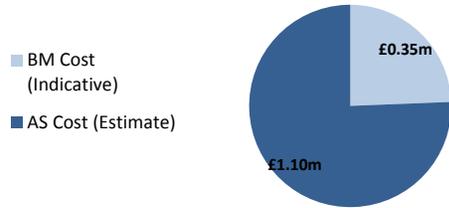

### Commentary

Additional response was held throughout the day due to demand uncertainty. 460MW of STOR was utilised in the morning to aid with unexpected demand partly due to lower than expected levels of solar generation. Trades were conducted on the I/Cs for positive reserve in the evening. BM actions were required to solve ROCOF issues on a BM unit.

**Western Link status: Available**