



Date: 10/01/2019

BSUoS Charge Estimate: £1.04/MWh
Total Outturn: £1.44m




Daily Balancing Costs



■ BM Cost (Indicative)
■ AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

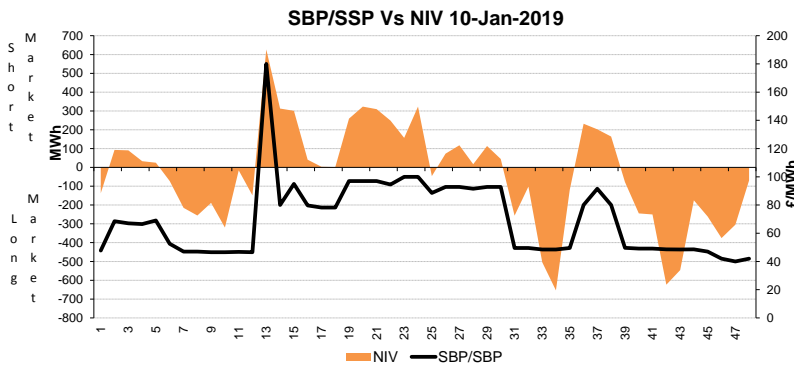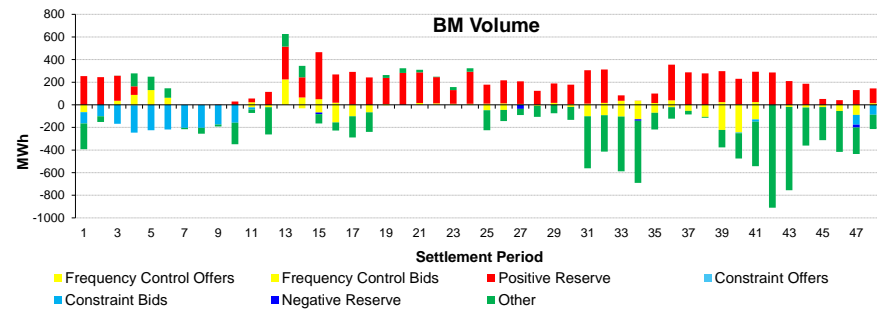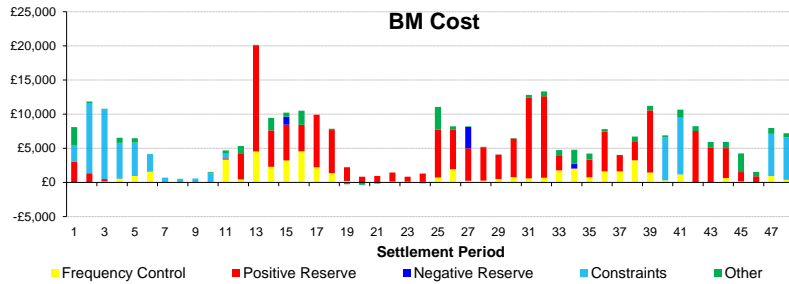

Western Link status: Unavailable

Commentary

Trades were carried out on the interconnectors from the morning pick up through to the early afternoon for positive reserve. 370MW of STOR run in the morning due to shortfalls in wind. Extra response held over the morning pick up and through the evening due to frequency and demand uncertainty. Trades and BM actions were taken to manage constraints in the south east. Voltage requirements met by market.