
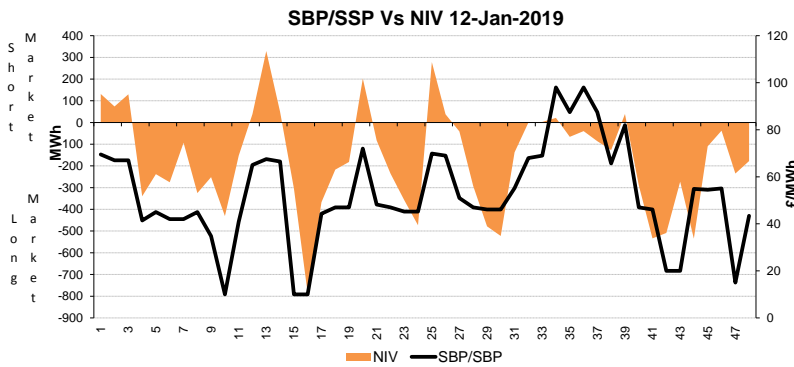
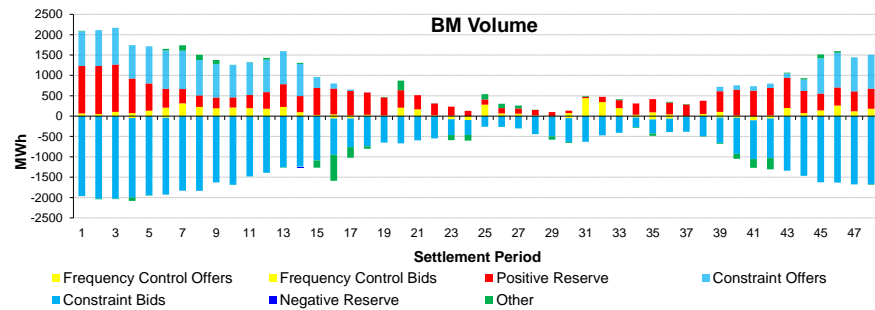
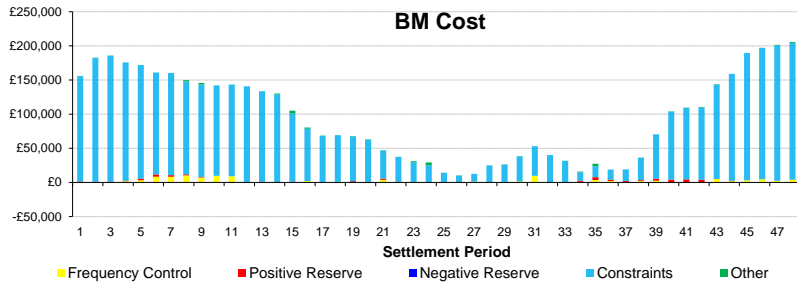
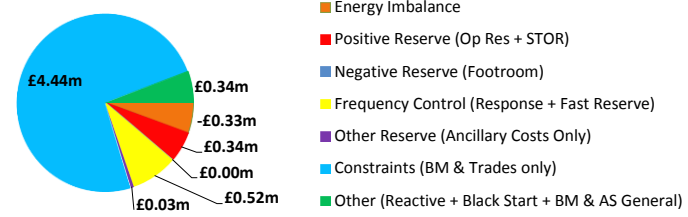


Date: 12/01/2019

BSUoS Charge Estimate: £3.84/MWh
Total Outturn: £5.34m

Daily Balancing Costs

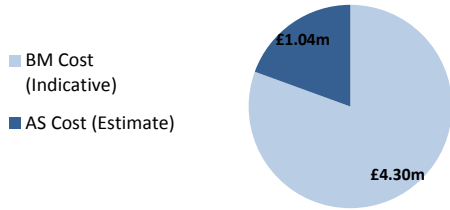

Western Link status: Available

Commentary

682MW of STOR was run to cover generation shortfalls over the darkness peak. Additional response was held throughout the day due to wind and demand uncertainty. High winds throughout the day resulted in a large number of trades and BM actions being taken to resolve constraints in Scotland and the Scotland England border. Trades on the I/Cs and BM units supported by additional BM actions were required to solve ROCOF constraints overnight and through the day. Additionally trades were also required to manage voltage levels in the North West, North, Midlands, South and South East.