



Date: 14/01/2019

BSUoS Charge Estimate: £1.48/MWh
Total Outturn: £2.08m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

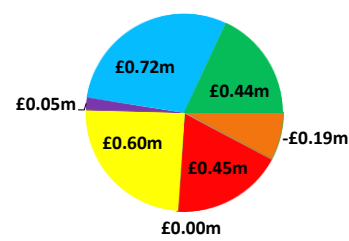

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

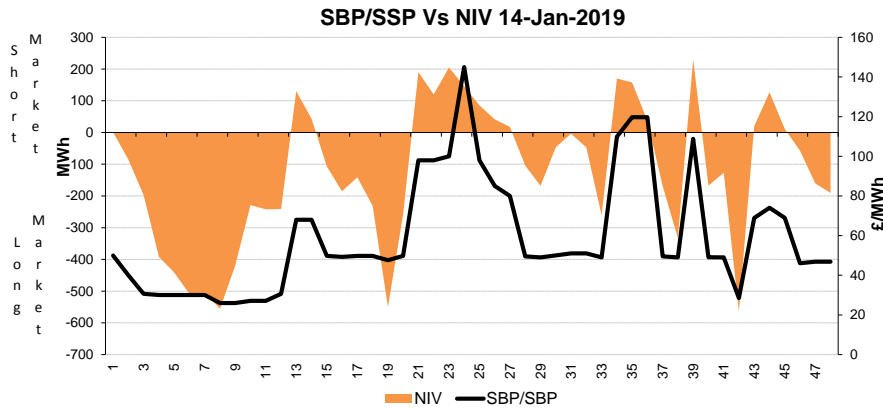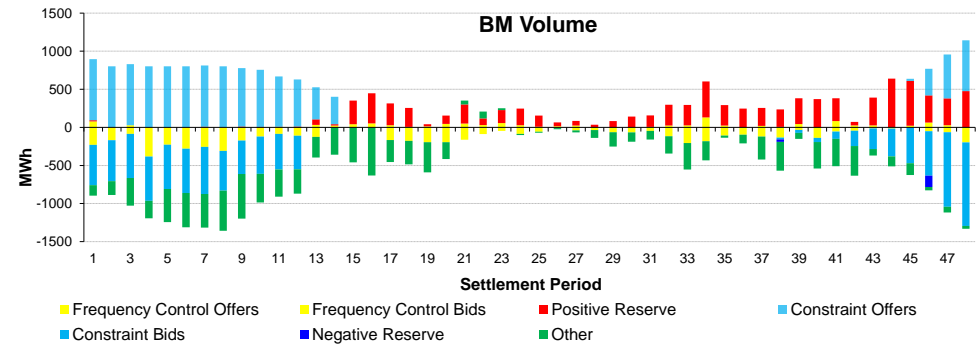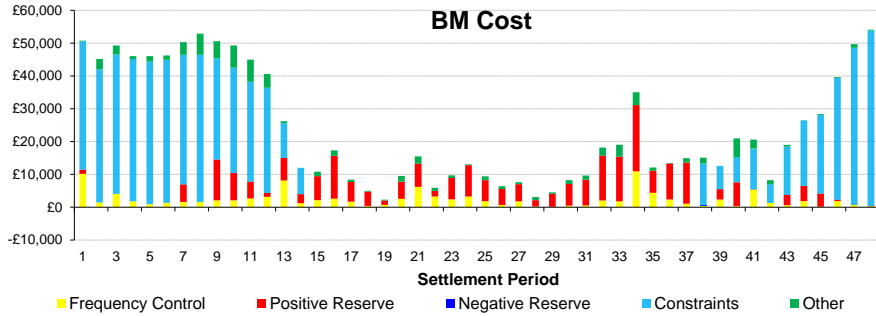

Western Link status: Available

Commentary

300MW of STOR was run over the darkness peak to manage higher than expected demand due to lower than expected levels of demand management. Additional response was held in evening to manage wind volatility. Overnight interconnector trades were carried out to manage RoCoF issues and also trades and BM actions were taken overnight to manage voltage levels. In evening, BM actions were taken to manage constraints in Scotland.