
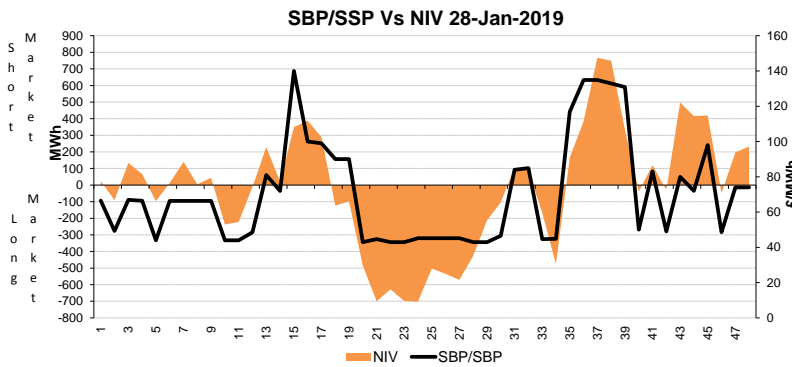
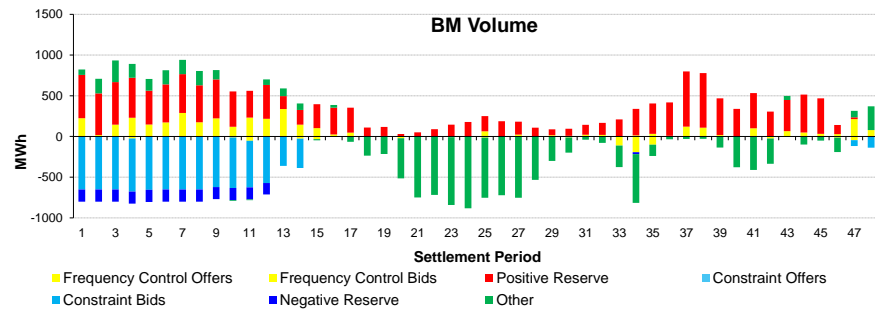
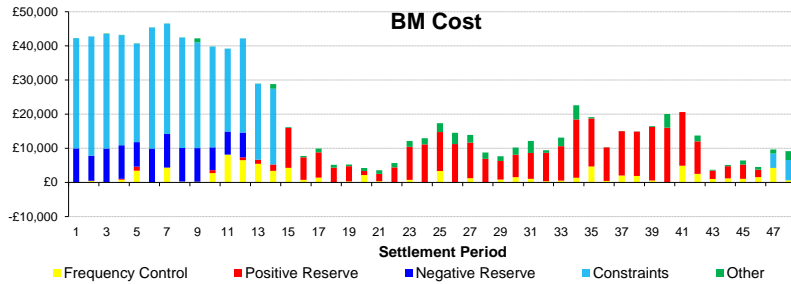
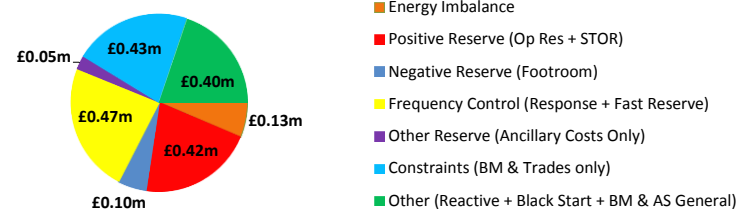


Date: 28/01/2019

BSUoS Charge Estimate: £1.40/MWh
Total Outturn: £2.00m

Daily Balancing Costs

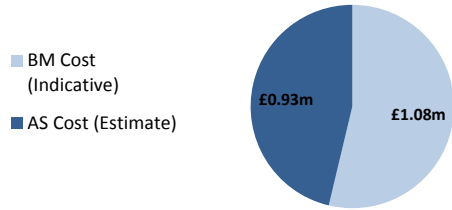

Western Link status: Unavailable

Commentary

850MW of STOR was utilised for the morning pick up due to plant losses and wind shortfall with a further 234MW of STOR utilised over the darkness peak. A small amount of additional response was held through the daytime due to demand uncertainty. Trades on the interconnectors and BMUs along with BM actions were required to manage ROCOF levels overnight. All voltage requirements were met by the market.