
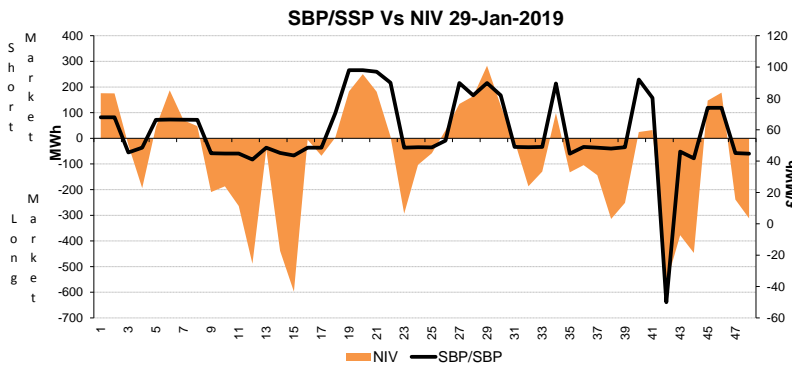
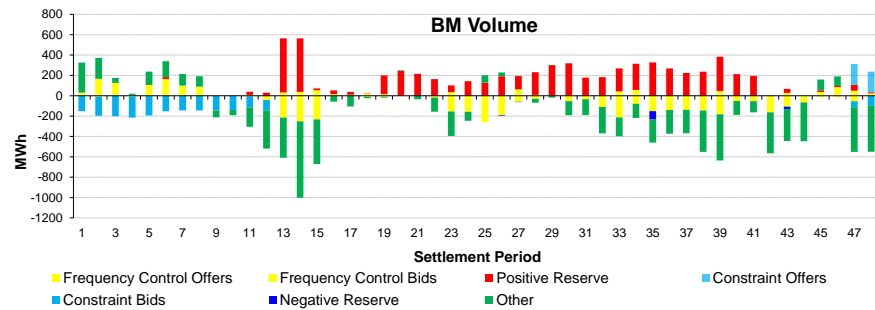
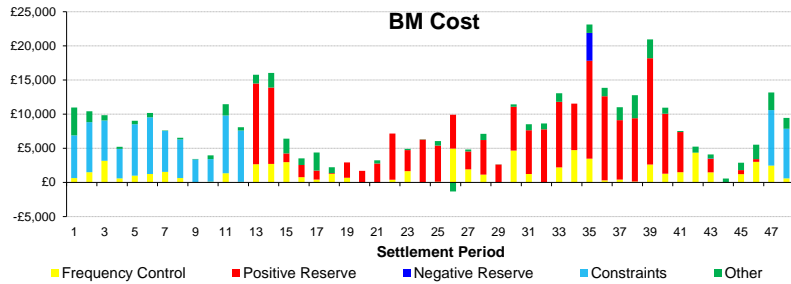
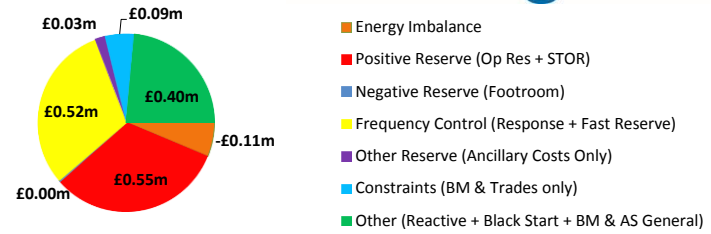


Date: 29/01/2019

BSUoS Charge Estimate: £1.05/MWh  
Total Outturn: £1.49m

# Daily Balancing Costs

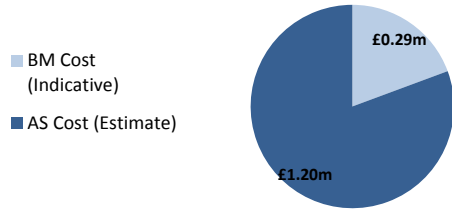

## Commentary

Trades were carried out on the Interconnectors for positive reserve over the morning pick up. Additional response was held throughout the day for demand uncertainty and frequency performance. Trades and BM actions were required to deal with ROCOF levels overnight. No other system actions were taken with all voltage requirements met by the market.

**Western Link status: Unavailable**