
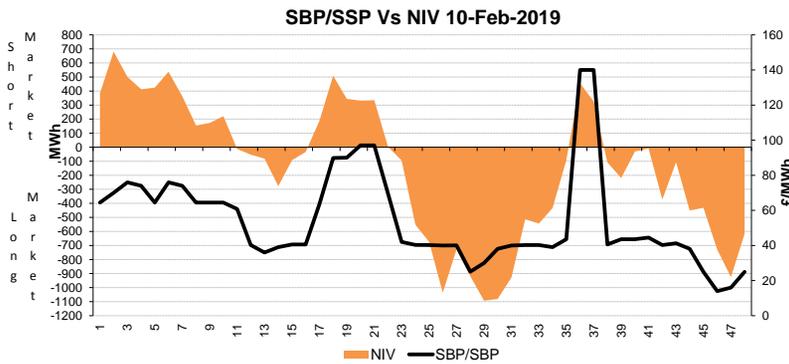
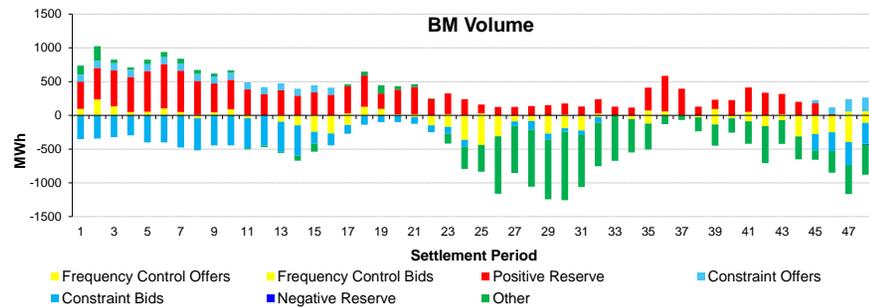
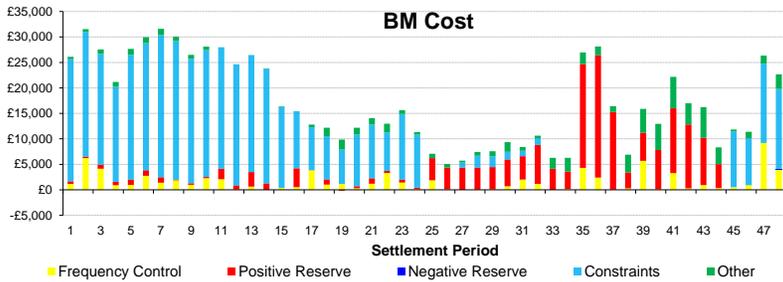
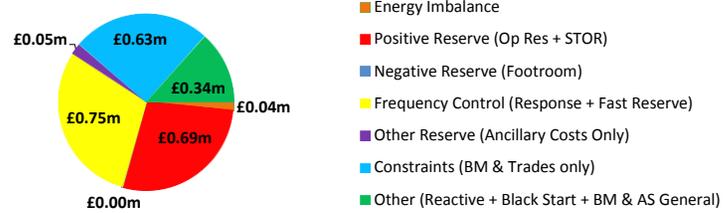


Date: 10/02/2019

BSUoS Charge Estimate: £1.93/MWh
Total Outturn: £2.51m

Daily Balancing Costs

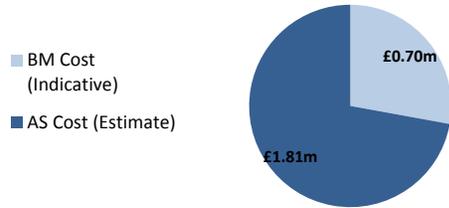

Commentary

200MW of STOR was utilised in the morning and a further 337MW of STOR utilised over the darkness peak. Additional demand was held through the middle of the day due to wind volatility. Trades on the I/Cs and on BMUs coupled with BM actions were required to manage ROCOF levels overnight and through the day. Trades were also required to manage voltage levels in the North West. BM actions were taken due to constraints in Scotland.

Western Link status: Available