
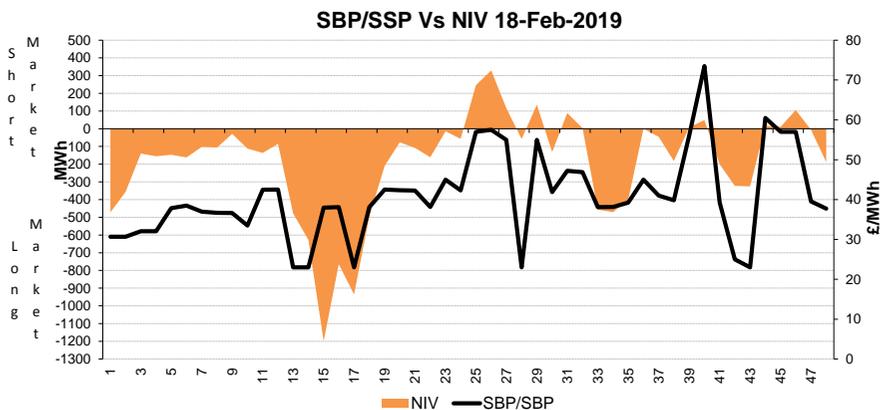
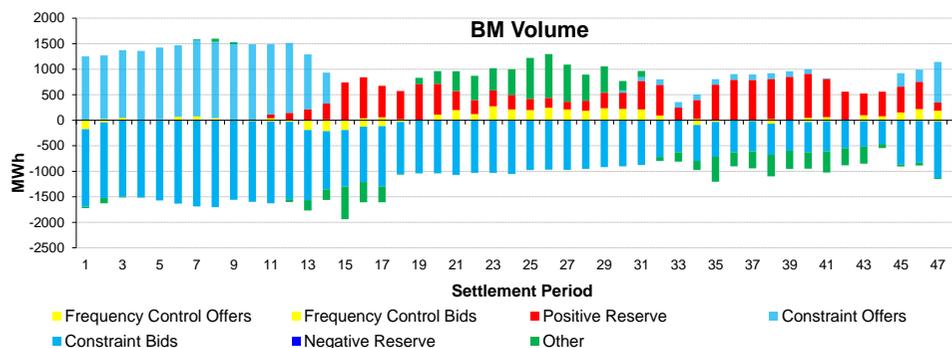
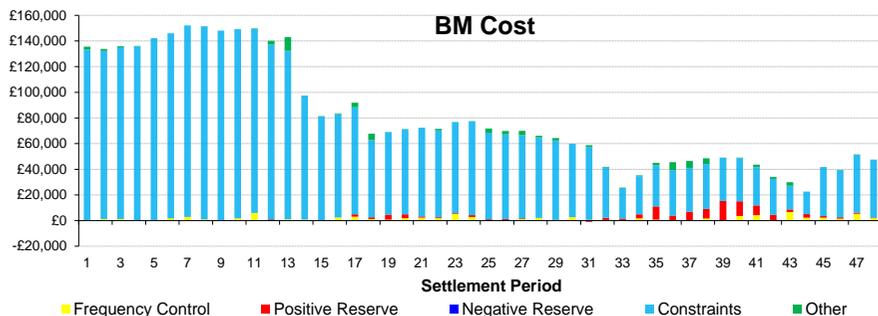
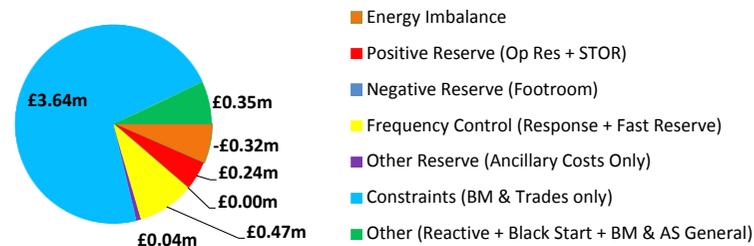


Date: 18/02/2019

BSUoS Charge Estimate: £3.03/MWh
Total Outturn: £4.42m

Daily Balancing Costs

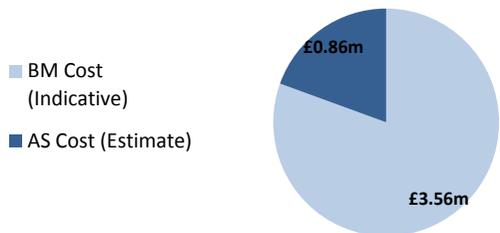

Western Link status: Available

Commentary

The market was predominantly long through the day with high levels of wind on the system. Additional response was held throughout the day for frequency performance risk and wind volatility. The high wind levels once again meant trades on the interconnectors and BMUs combined with BM actions were required to manage ROCOF levels. Voltage levels in the Midlands, South East, North West and South were managed via trades and BM actions. Further BM actions were utilised to solve constraints in Scotland and on the Scotland England border.