



Date: 01/03/2019




BSUoS Charge Estimate: £1.58/MWh  
Total Outturn: £2.13m

# Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

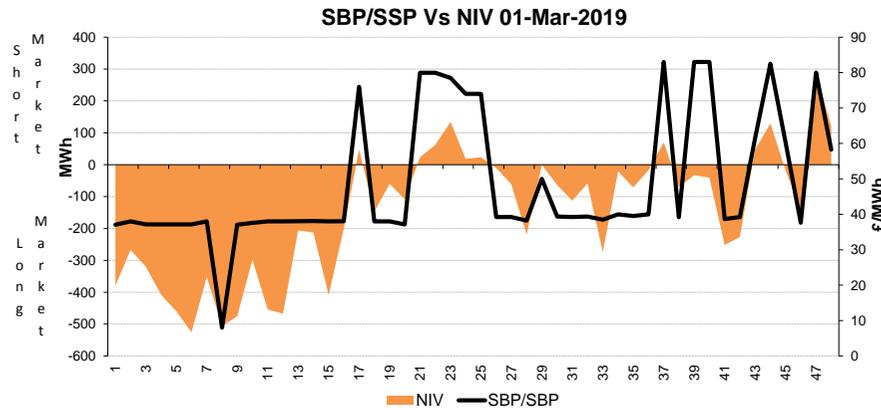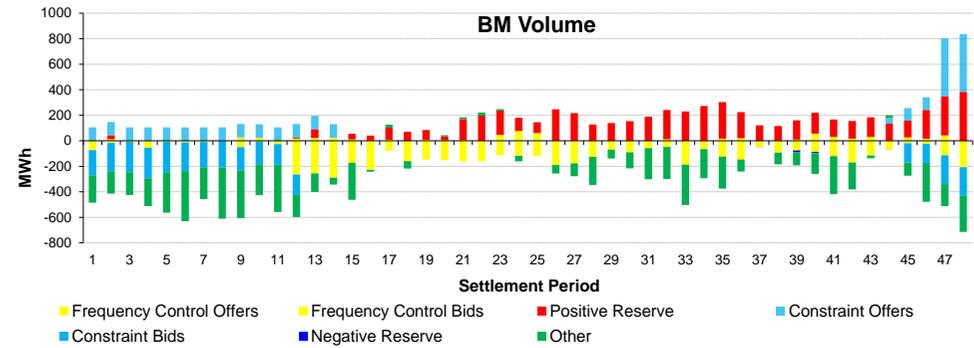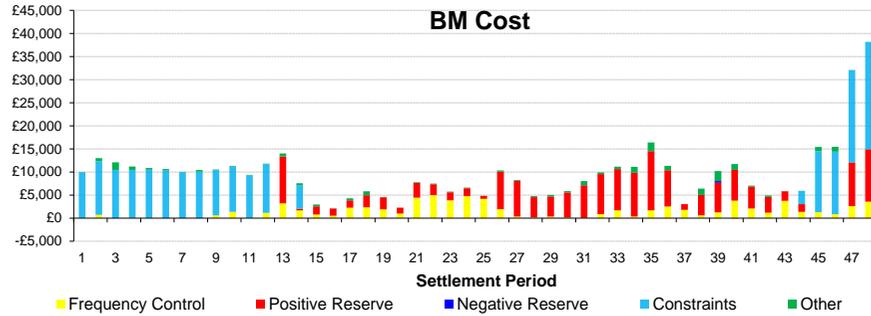

**Western Link status: Unavailable**

## Commentary

The market was up to 1GW long overnight. 250MW of STOR was run through the darkness peak. Additional response was held overnight for frequency performance risk. Trades were done on the interconnectors and BM units along with BM actions to manage ROCOF levels overnight. Trades were done to manage voltage levels in the North West. All other requirements met by the market.