



Date: 26/02/2019

BSUoS Charge Estimate: £1.05/MWh
Total Outturn: £1.15m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

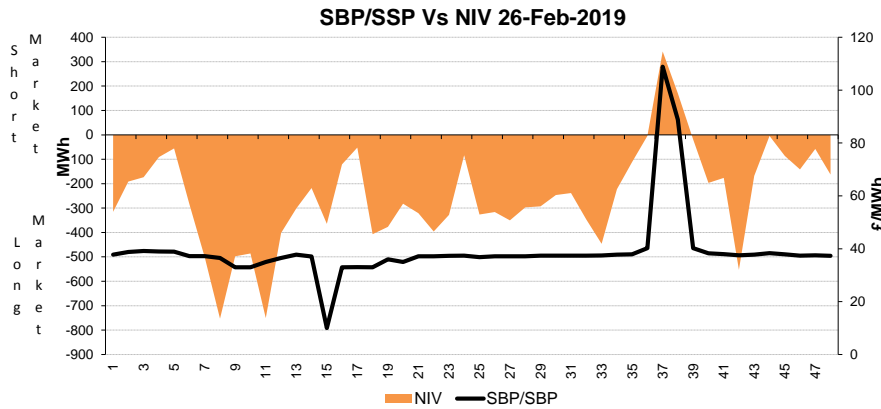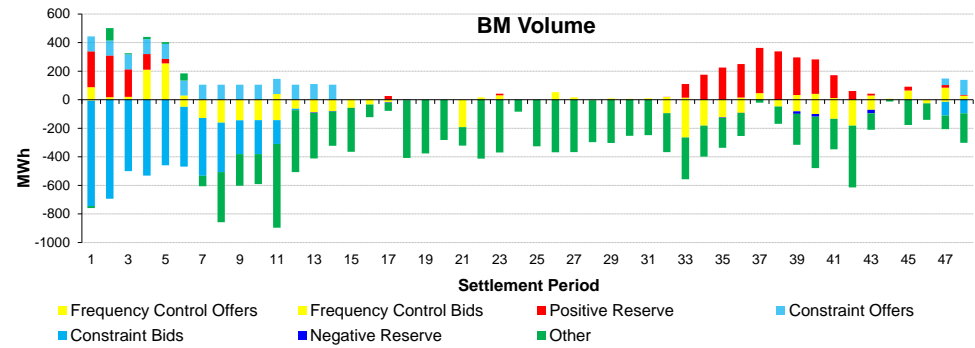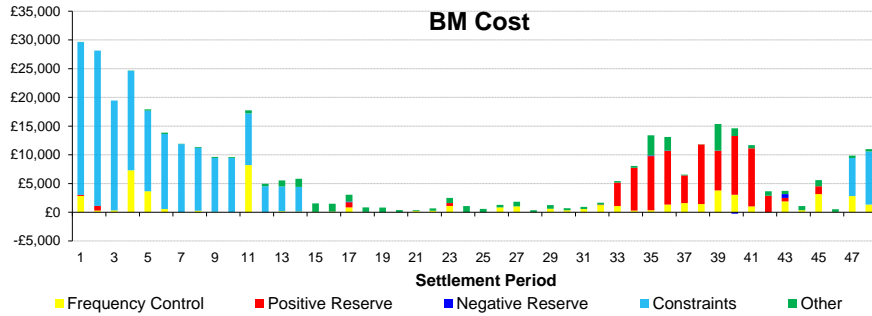

Western Link status: Unavailable

Commentary

The market remained long throughout the day, a part for the darkness peak when it was short in excess of 600MW. Some BM actions were taken overnight to solve power flow restrictions on the network boundary between England and Scotland. Trades on the interconnectors and on generating units and some BM actions were also taken to secure RoCoF level. Voltage levels in North of England were regulated with trades aswell.