






Date: Thursday 28 Mar 2019

BSUoS Charge Estimate: £2.06/MWh
Total Outturn: £2.66m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

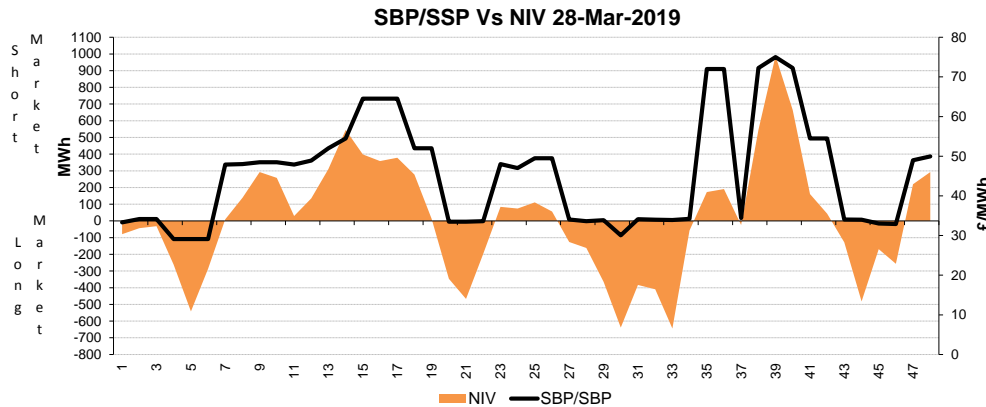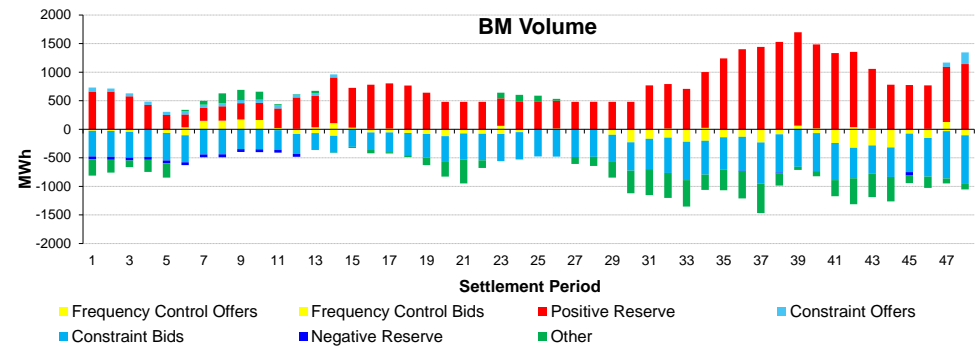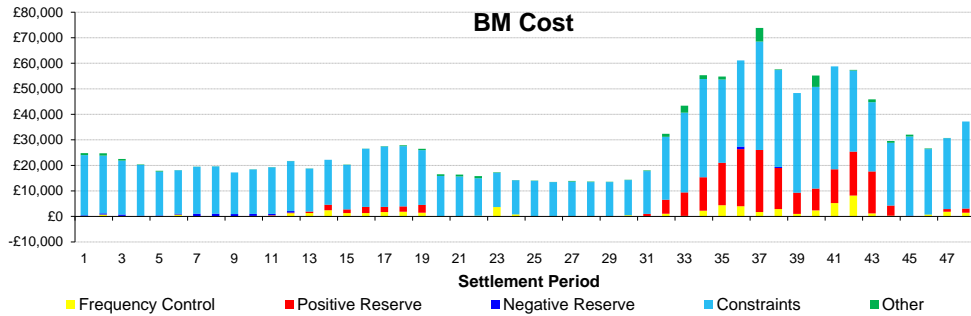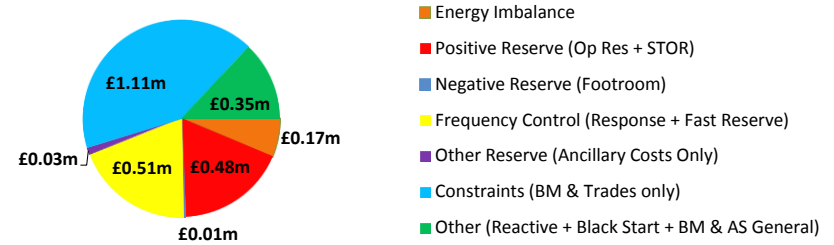

Commentary

System was short over the morning pick up and darkness peak. 300MW of demand STOR was utilised in the morning. Trades were done on the interconnectors for positive reserve in the early afternoon. Trades on the interconnectors and BM Units were used to manage overnight ROCOF levels. Trades were also used to manage voltage in the North West. BM actions were taken to manage power flow restrictions caused by planned outages in Scotland and South Wales.

Western Link status: Available